



SECTION A-A

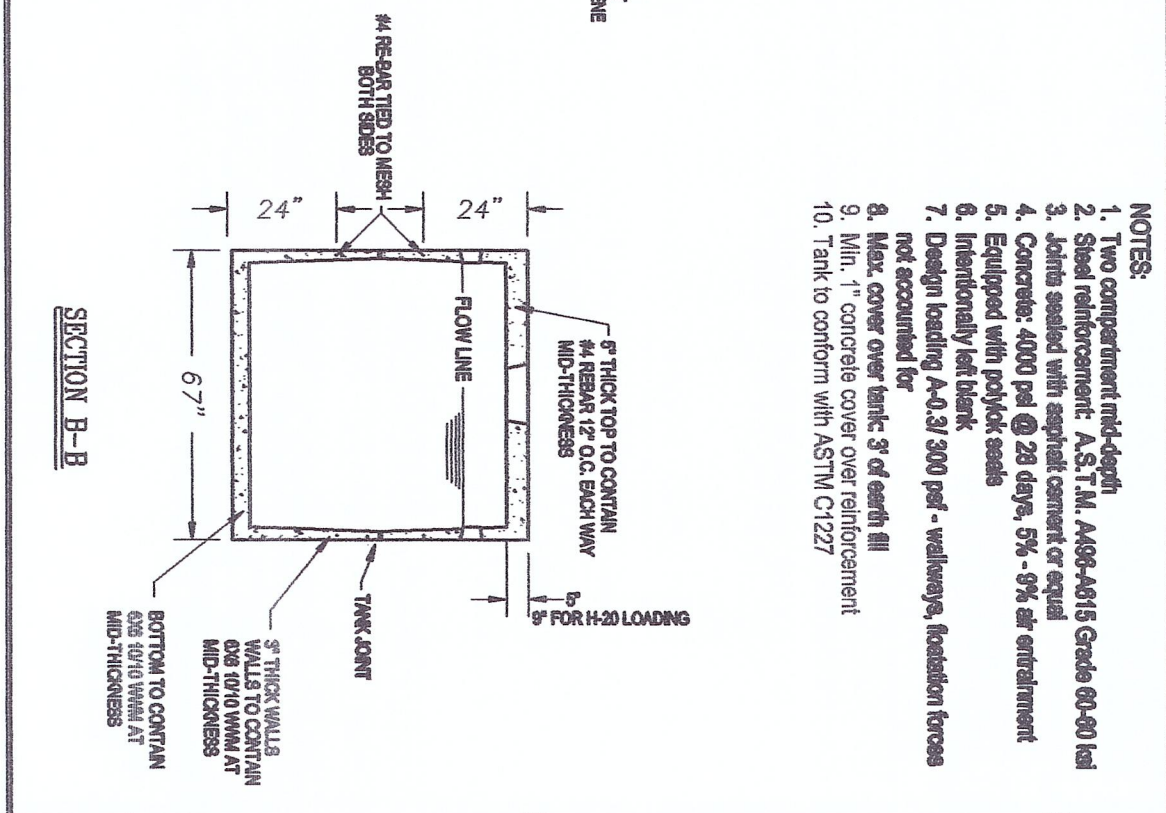

PLAN VIEW

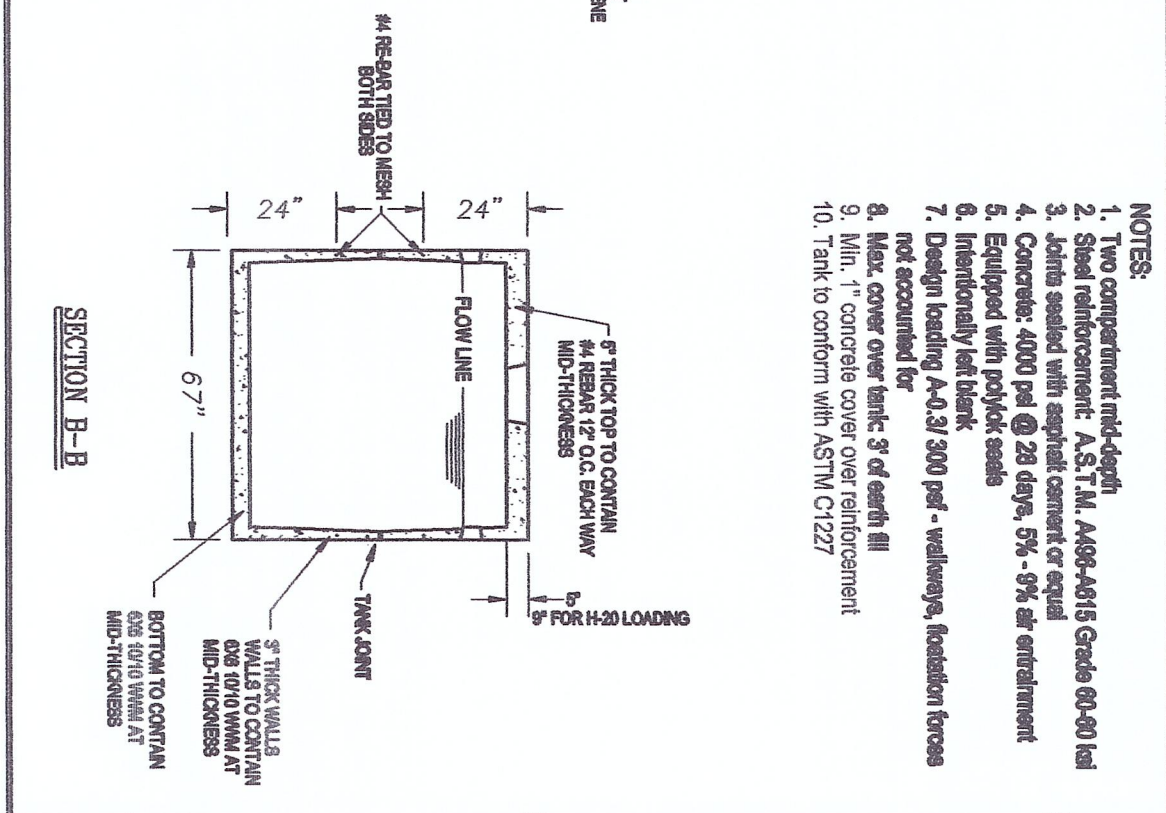

SECTION B-B

- NOTES:
1. Two compartment mid-depth
 2. Steel reinforcement: A.S.T.M. A198-A815 Grade 60-80 ksi
 3. Joints sealed with asphalt cement or equal
 4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
 5. Equipped with polyok seals
 6. Intentionally left blank
 7. Design loading A-0.3/300 psf - walkways, flotation forces not accounted for
 8. Max. cover over tank: 3" of earth fill
 9. Min. 1" concrete cover over reinforcement
 10. Tank to conform with ASTM C1227

 <p>MHCP MID-HOB CONCRETE PRODUCTS ROUTE 9, COLD SPRING, NY 10516 (914) 265-3285</p>	<p>PRODUCT SPECIFICATION 1500 GALLON MID SEAM SEPTIC TANK</p>		<p>DRAWING NUMBER: 1500-ST-MS</p>
			<p>DATE: 2/12/12</p>