

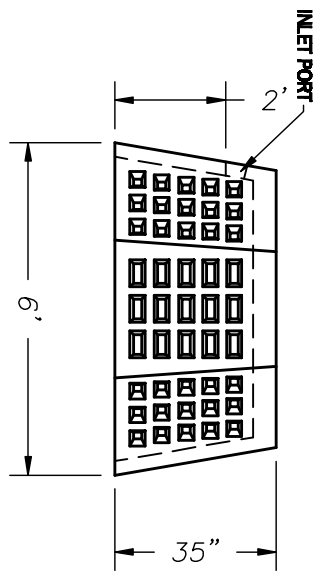


PLAN VIEW

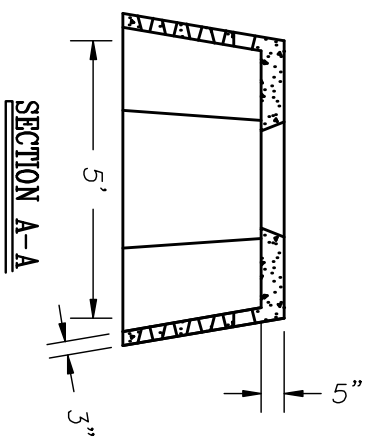

SIDE VIEW



SECTION A-A

- NOTES:**
1. Intentionally left blank
  2. Steel reinforcement: A.S.T.M. A193-A615 Grade 60-60 ksi
  3. Intentionally left blank
  4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
  5. Intentionally left blank
  6. Intentionally left blank
  7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
  8. Max. cover over tank: 3' of earth fill
  9. Min. 1" concrete cover over reinforcement
  10. Tank to conform with ASTM C1227

DRAWING NUMBER:  
370-DW  
DATE: 2/14/2012

PRODUCT SPECIFICATION  
370 GALLON DRY WELL

