




CENTER VIEW / END SEC.

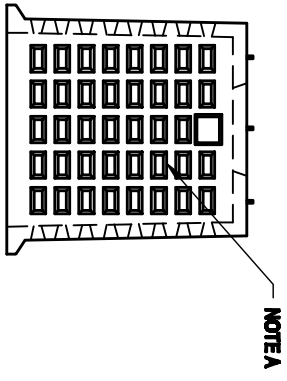

END VIEW / END SEC.



END VIEW / CENTER SEC.



SIDE VIEW / END SEC.

- NOTES:**
1. Intentionally left blank
  2. Steel reinforcement: A.S.T.M. A196-A615 Grade 60-60 ksi
  3. Intentionally left blank
  4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
  5. Intentionally left blank
  6. Intentionally left blank
  7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
  8. Max. cover over tank: 3' of earth fill
  9. Min. 1" concrete cover over reinforcement
  10. Tank to conform with ASTM C1227
- NOTE A: END SECTION (117) 5" X 2.5" HOLES  
CENTER SECTION (78) 5" X 2.5" HOLES