




CENTER VIEW / END SEC.

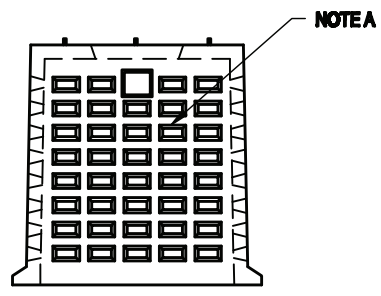

END VIEW / END SEC.



END VIEW / CENTER SEC.




SIDE VIEW / END SEC.

**NOTES:**

1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Intentionally left blank
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Intentionally left blank
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

NOTE A: END SECTION (117) 5" X 2.5" HOLES  
CENTER SECTION (78) 5" X 2.5" HOLES

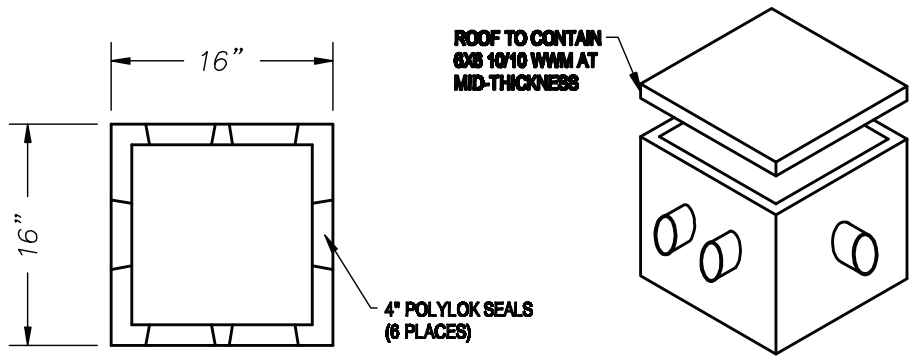


TOP VIEW

SIDE VIEW


**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. **Equipped with polylok seals**
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. Tank to conform with ASTM C1227

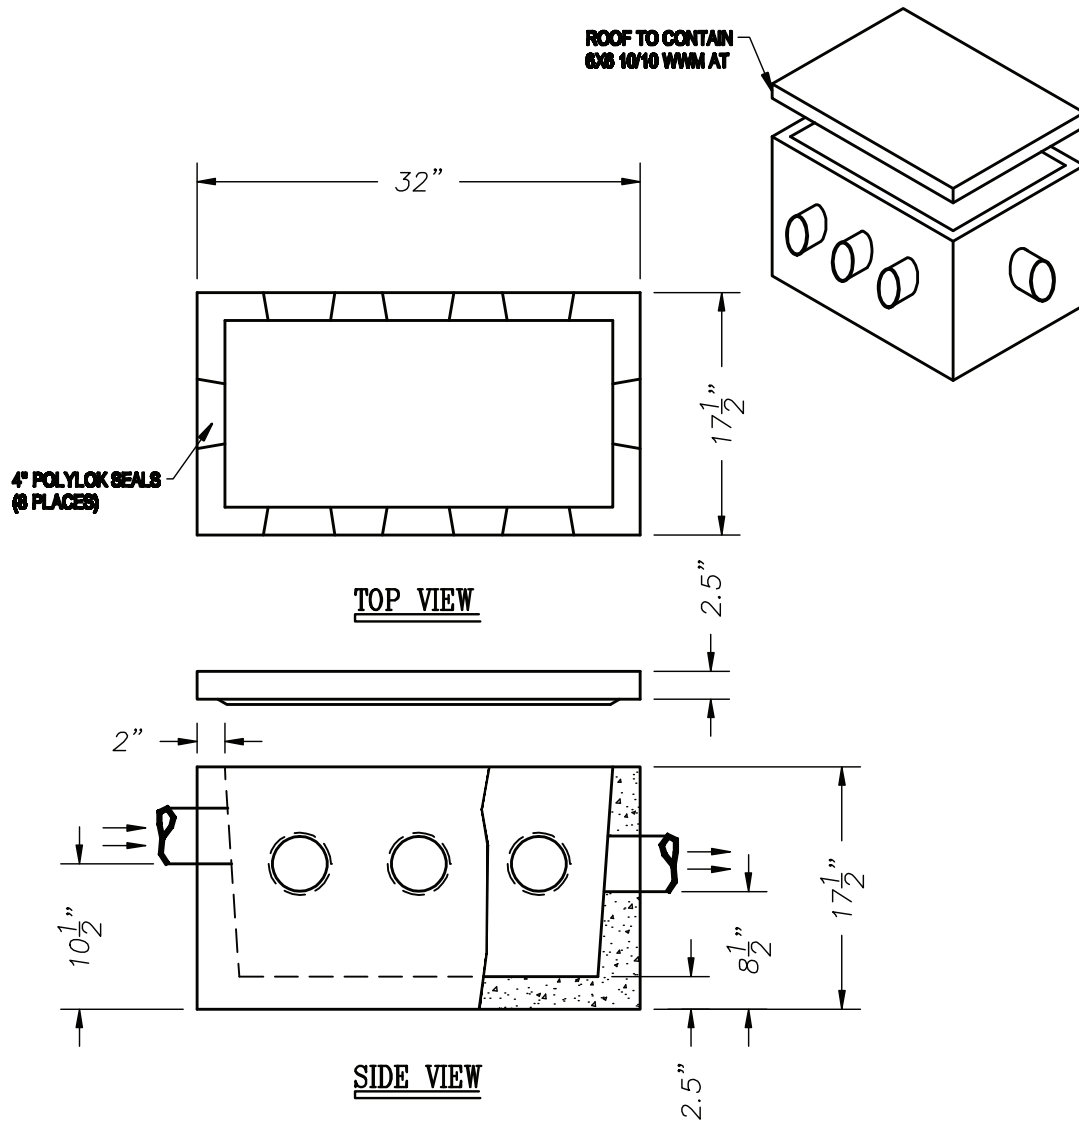


**NOTES:**


1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. **Equipped with polylok seals**
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**

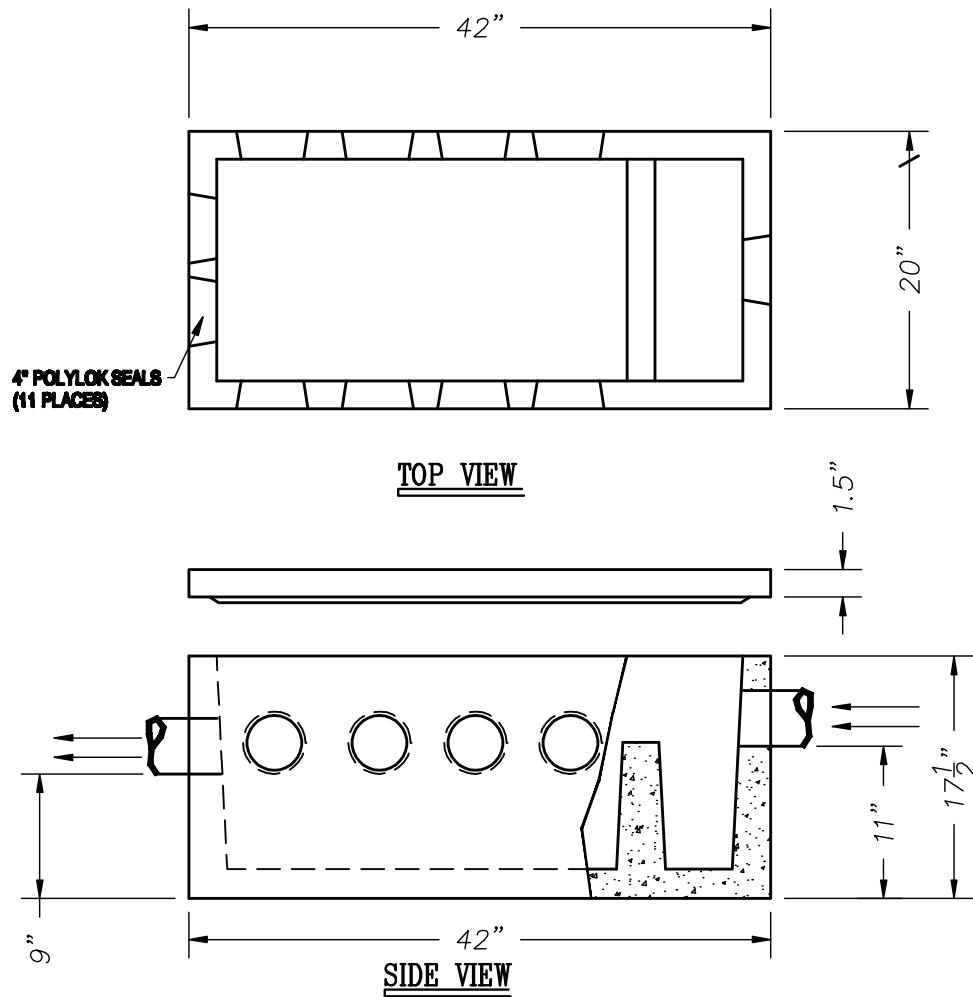

**NOTES:**


1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. **Equipped with polylok seals**
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**

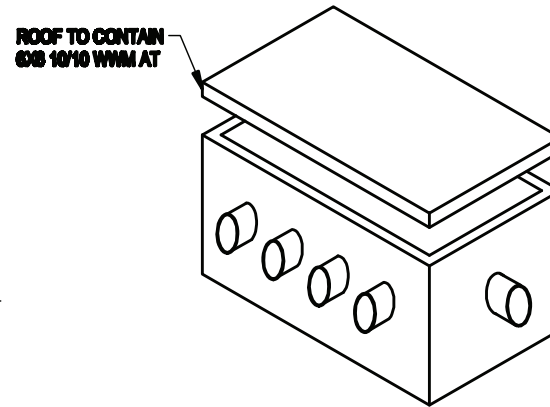


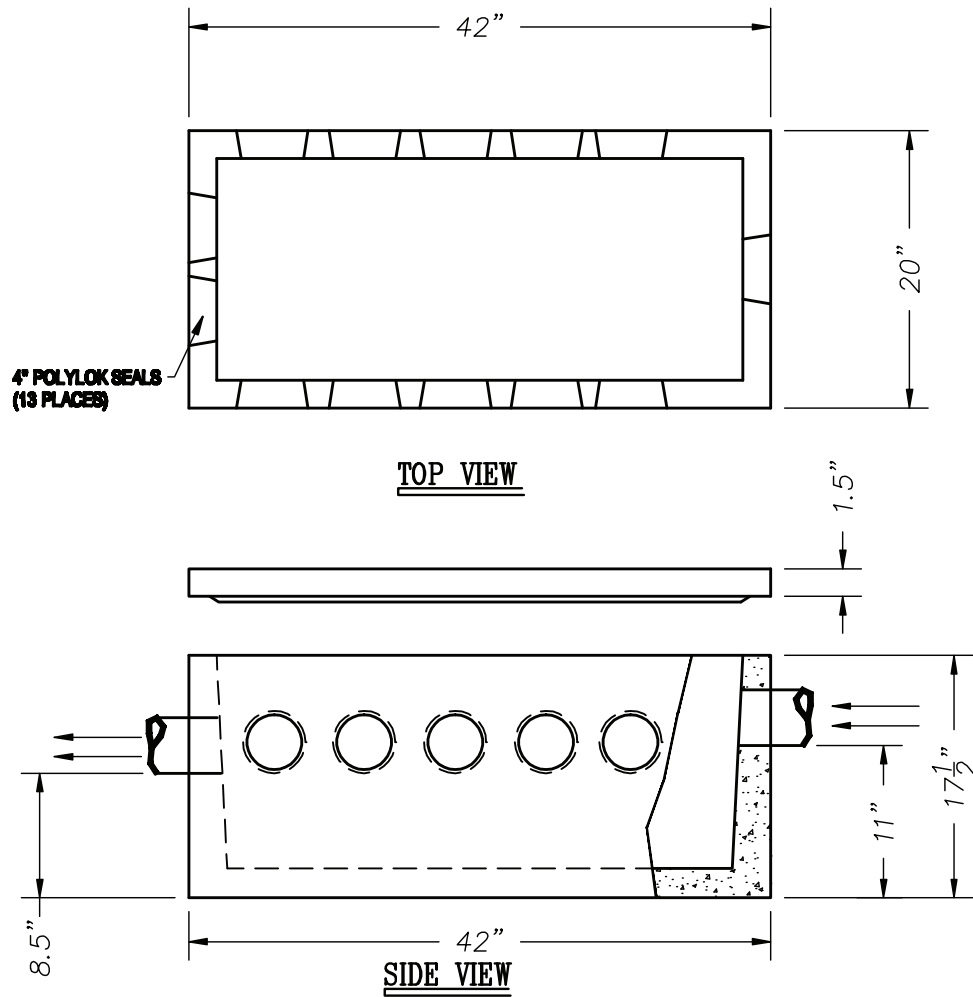

**NOTES:**


1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. **Equipped with polylok seals**
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**

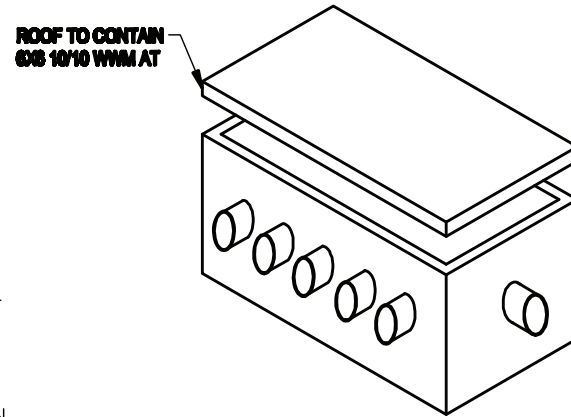


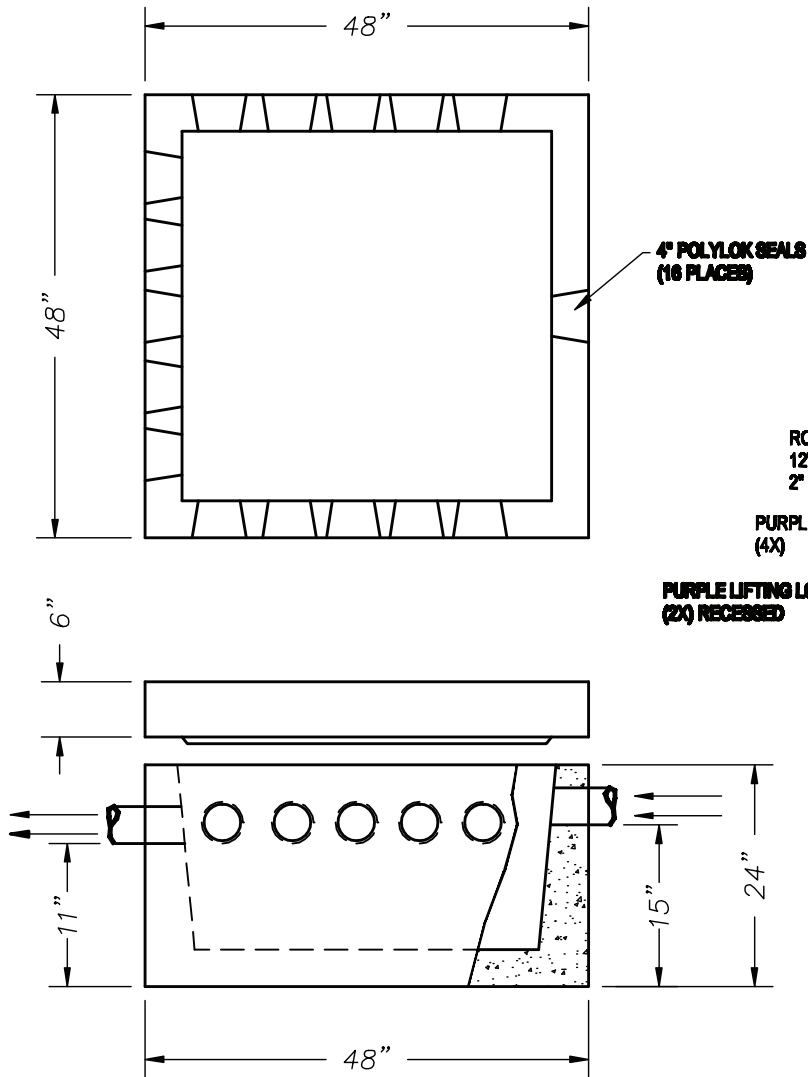

**NOTES:**




1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. **Equipped with polylok seals**
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**


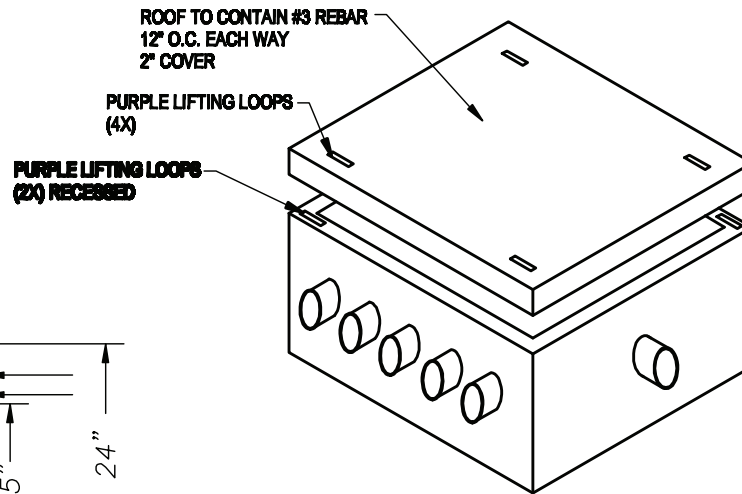


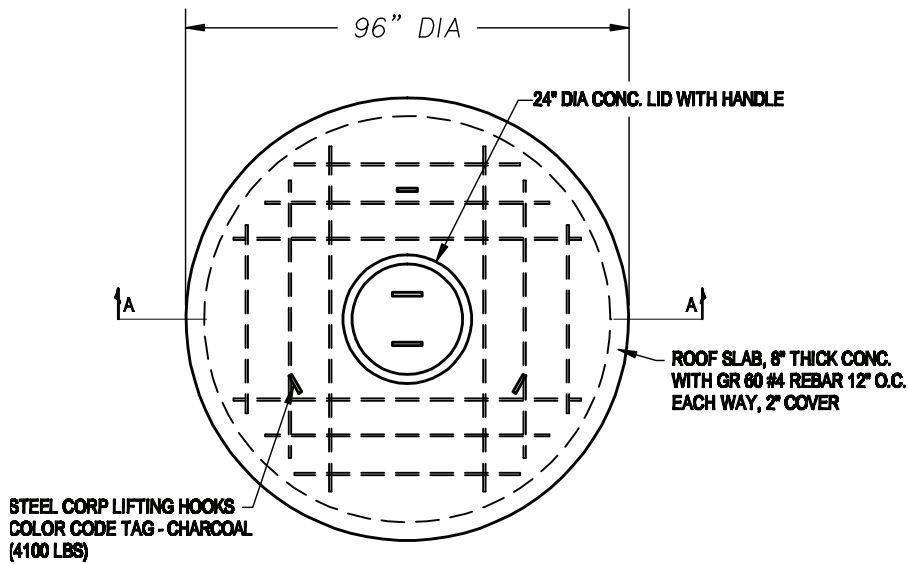

**NOTES:**

1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Intentionally left blank
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Intentionally left blank
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

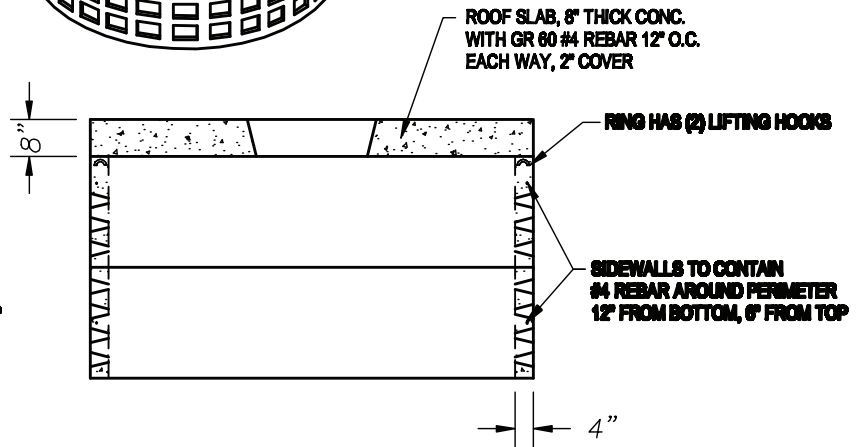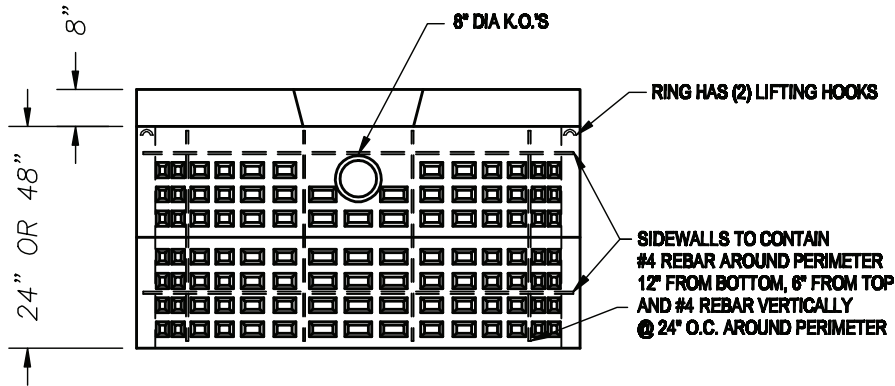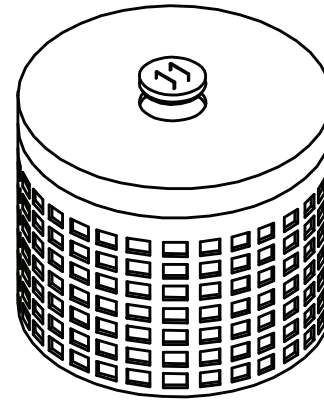

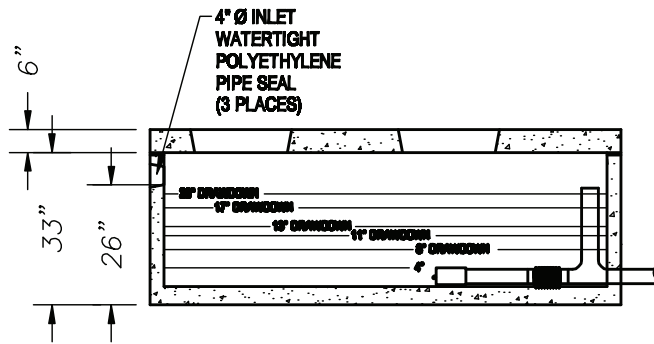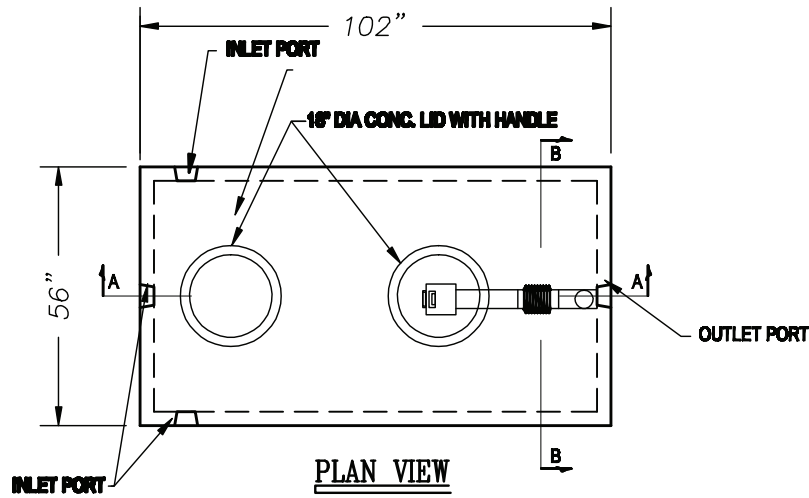


SECTION A-A

LENGTH	LOW LEVEL	DRAW	DOSE
102"	4"	8"	166 Gal
102"	4"	11"	229 Gal
102"	4"	13"	270 Gal
102"	4"	17"	353 Gal
102"	4"	20"	416 Gal





**NOTES:**

1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

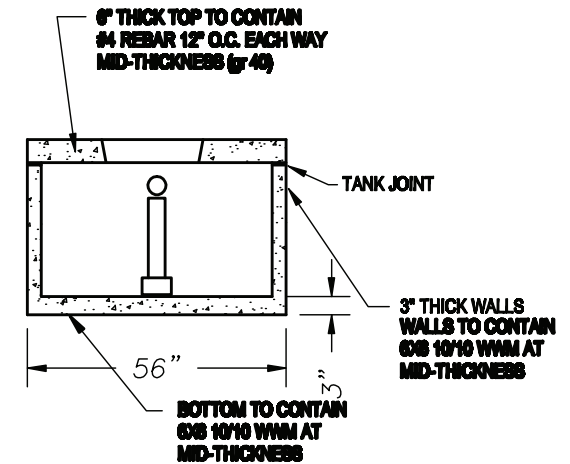



SECTION B-B



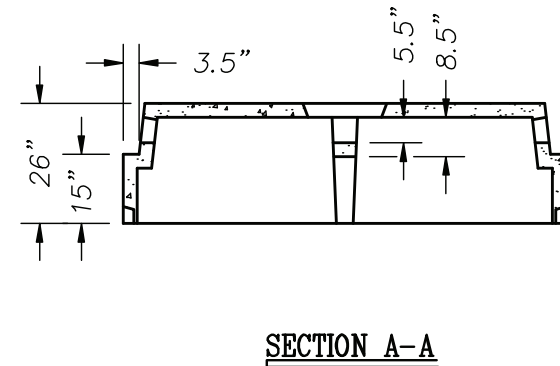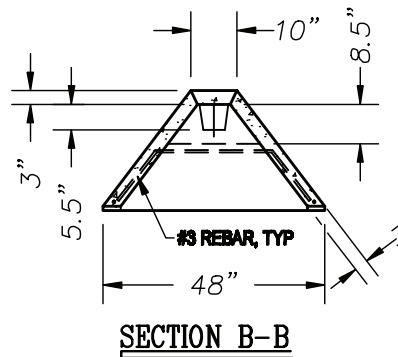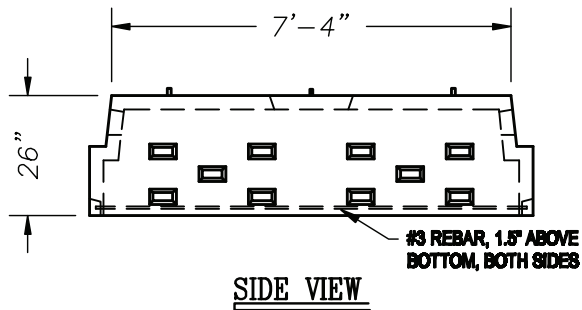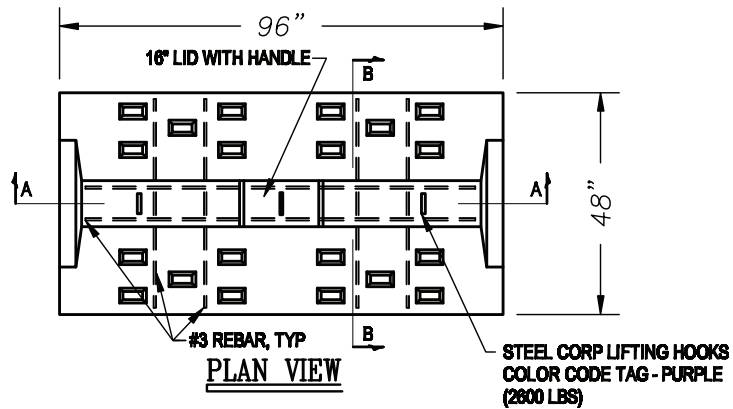



**NOTES:**



1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

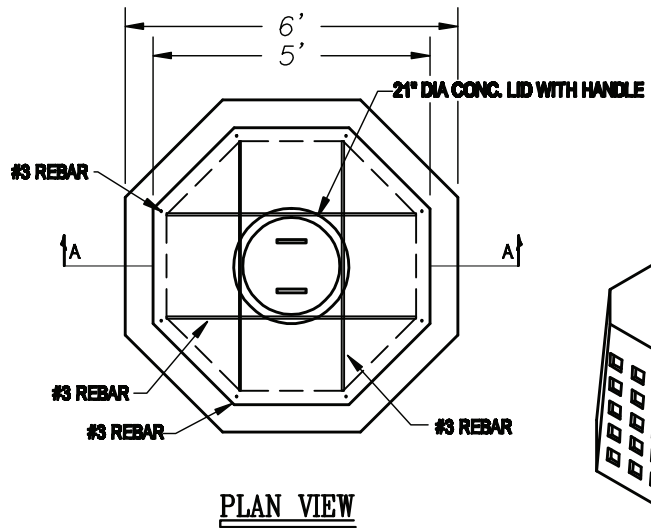

**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**

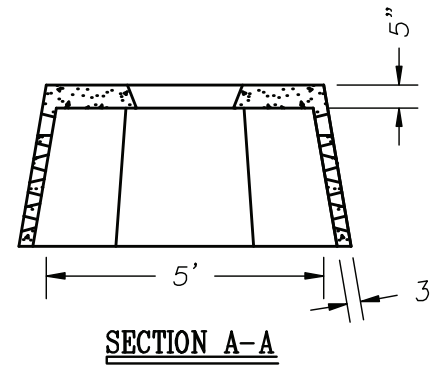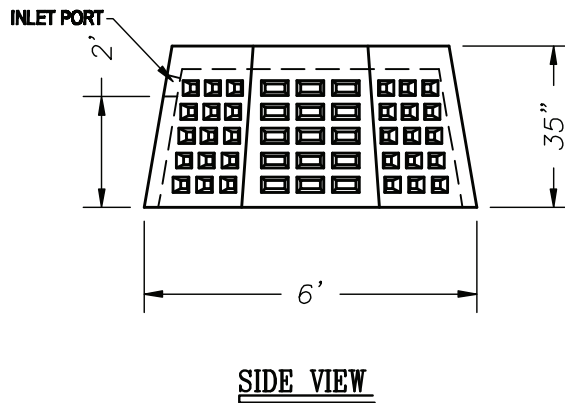


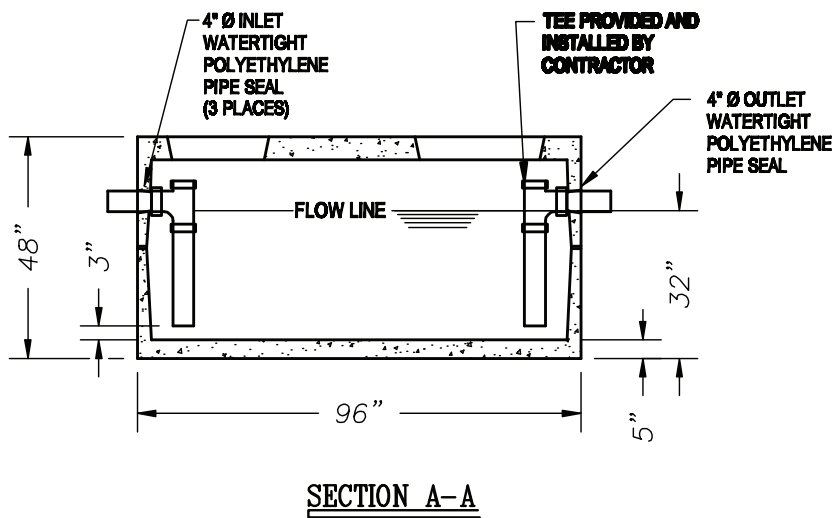
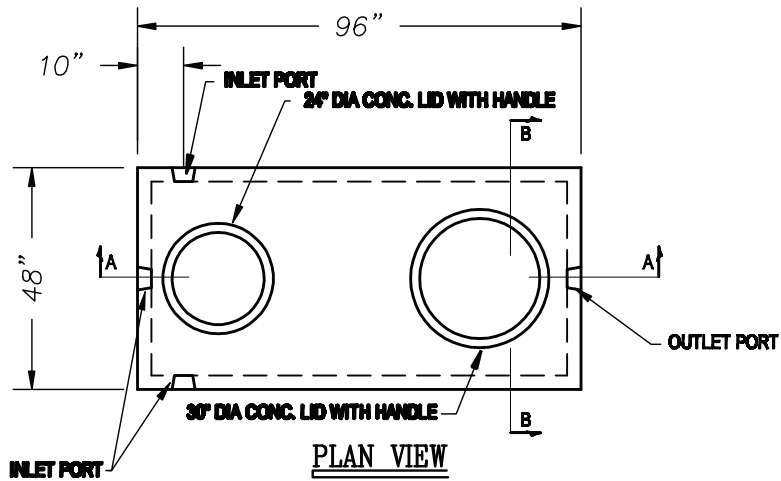


NOTE: PUMP TANK DOES NOT INCLUDE TEE BAFFLES

**NOTES:**



1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 pcf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227


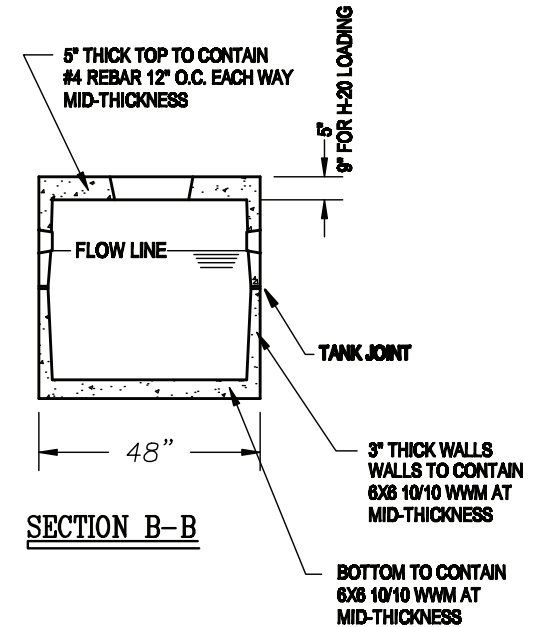


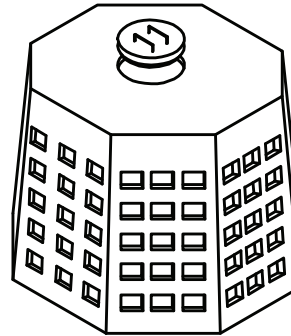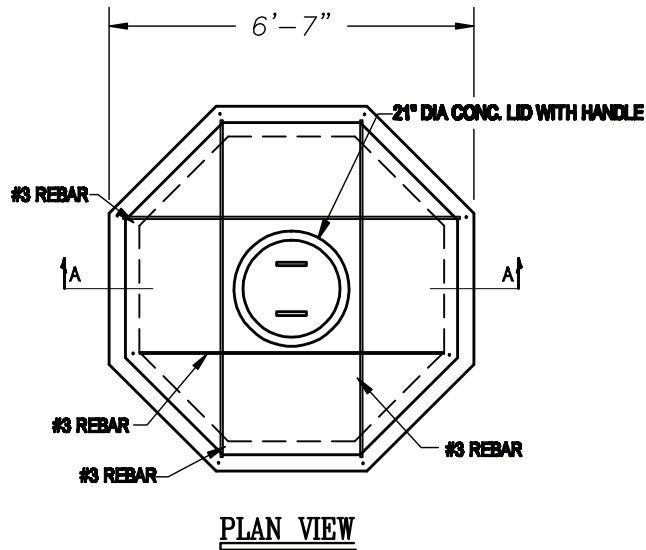

**NOTES:**


1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Intentionally left blank
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Intentionally left blank
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

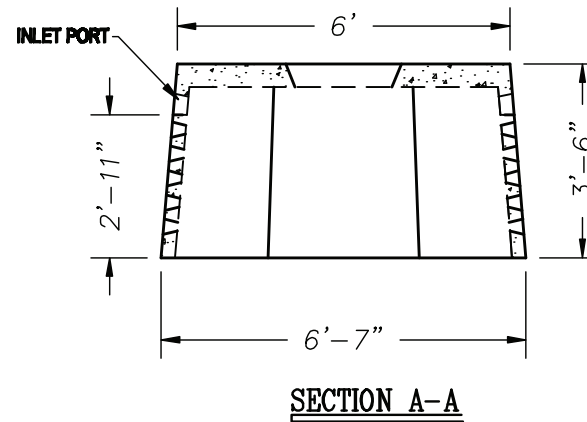
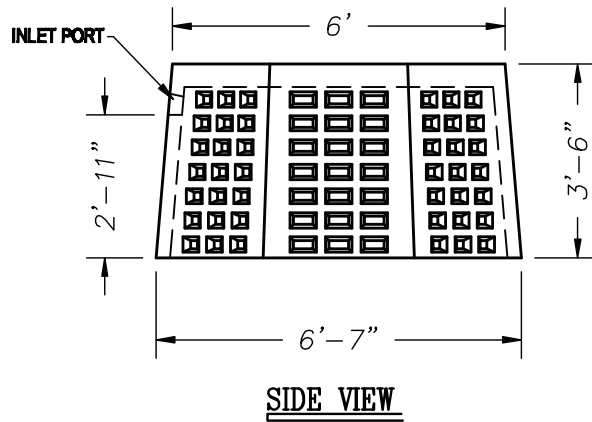


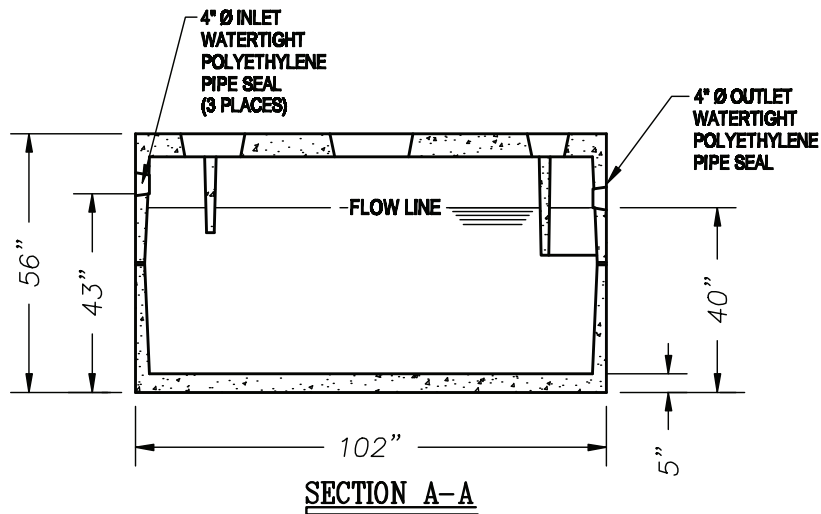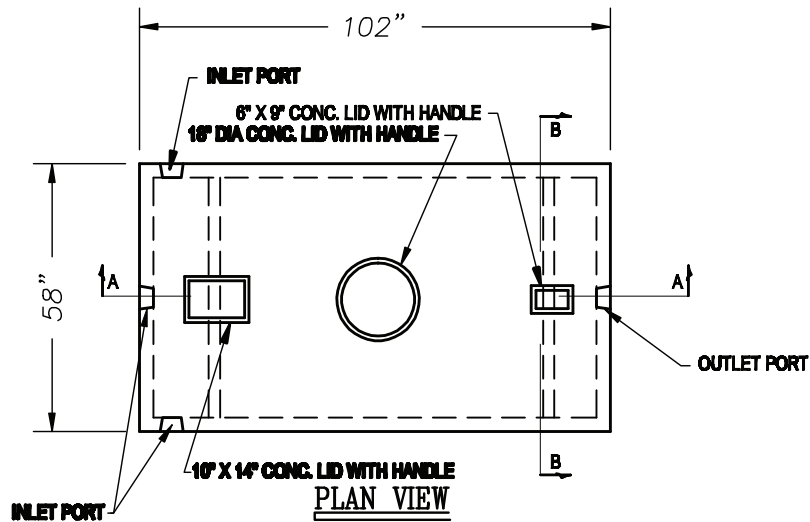

**NOTES:**


1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

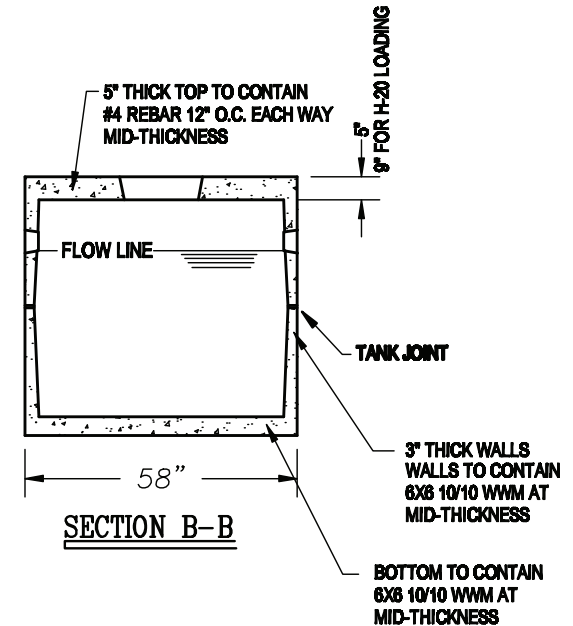


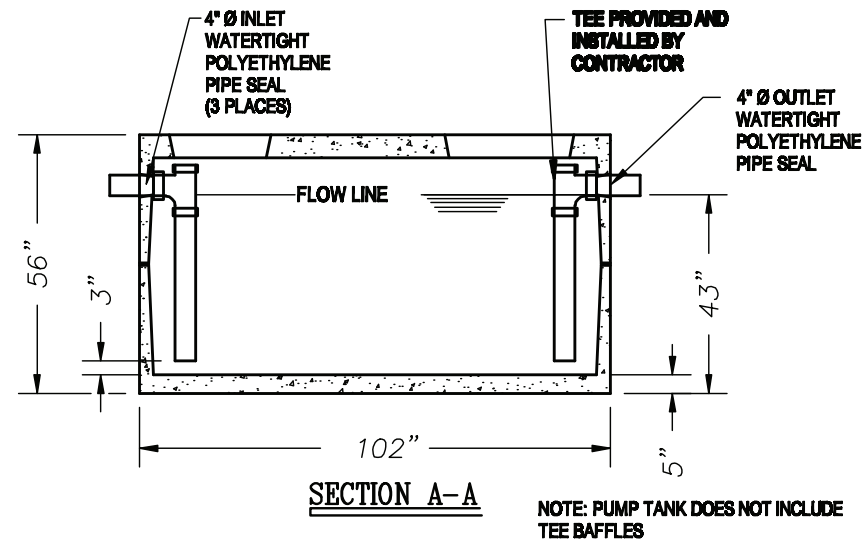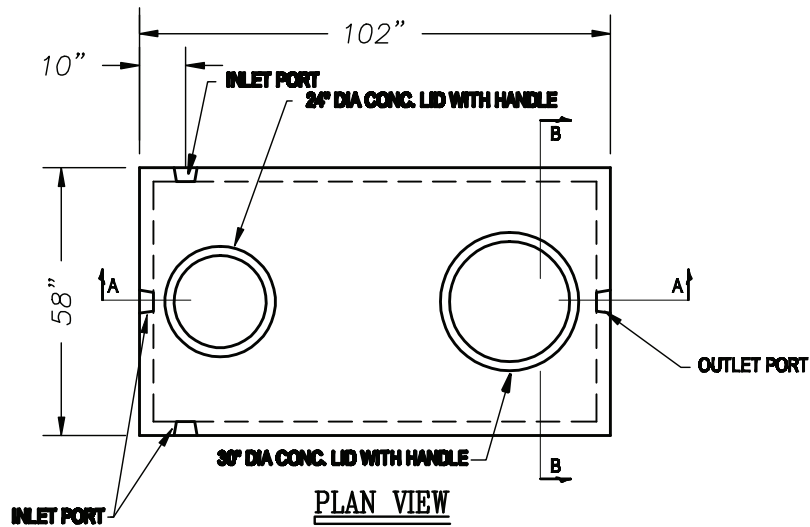


**NOTES:**

1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

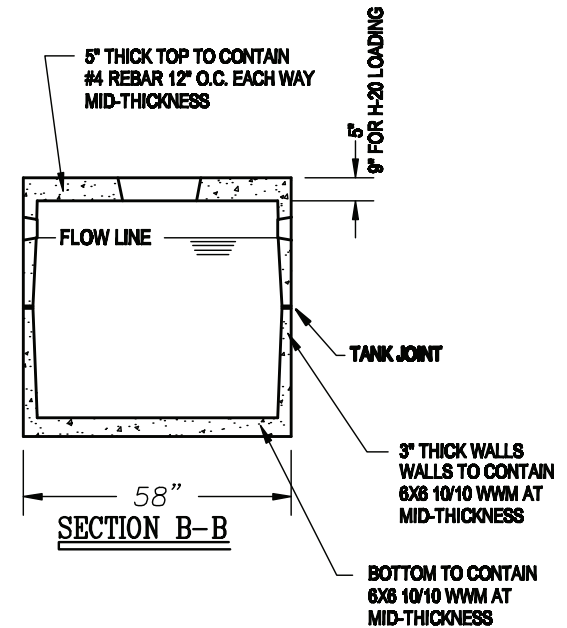


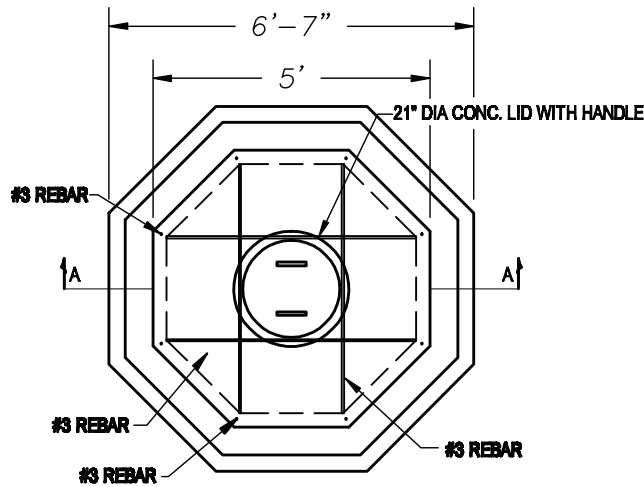

PLAN VIEW

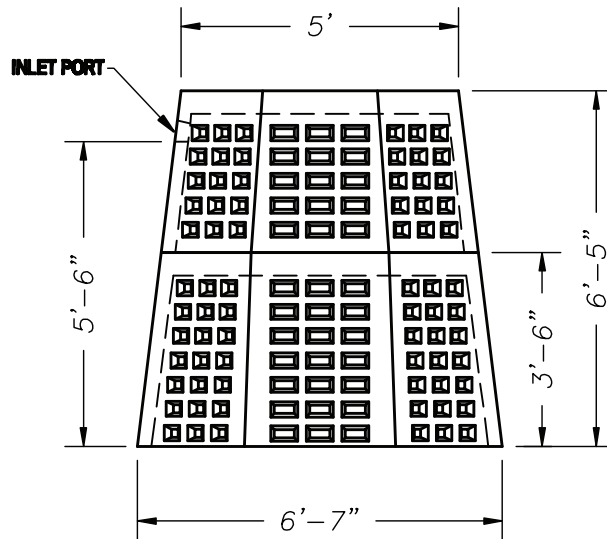



SIDE VIEW

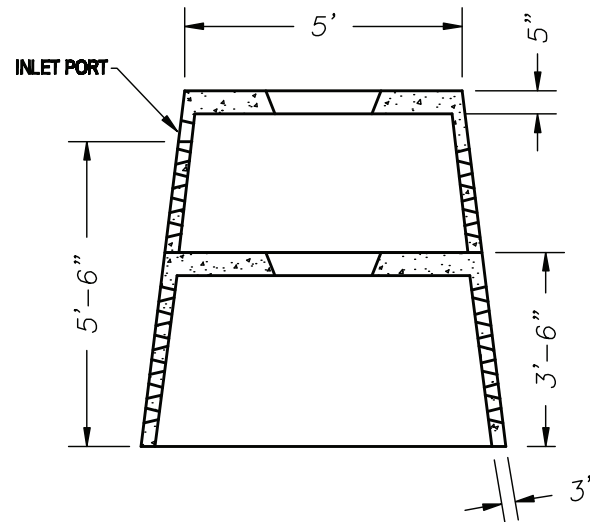

SECTION A-A

**NOTES:**


1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Intentionally left blank
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Intentionally left blank
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

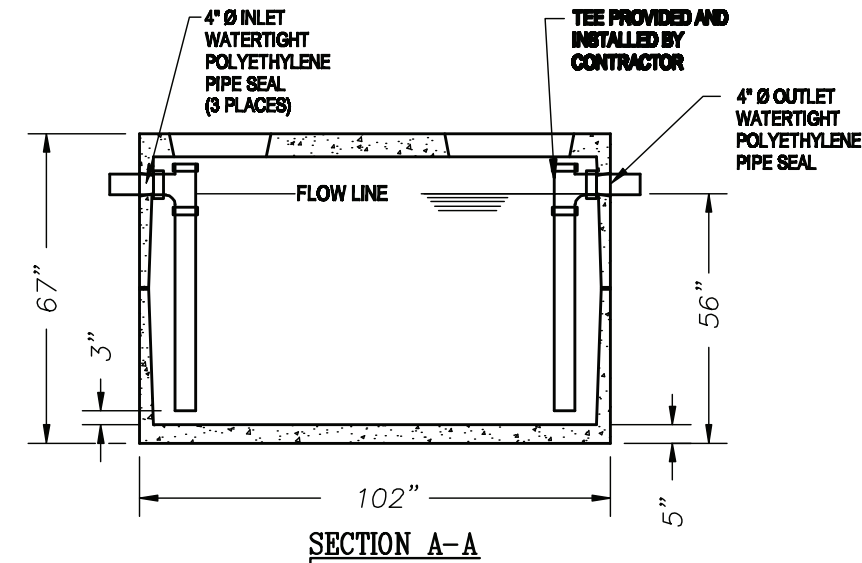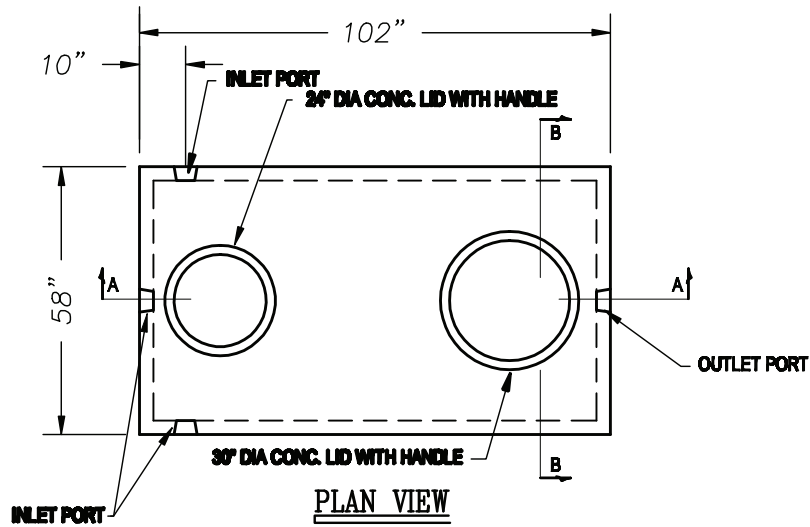



NOTE: PUMP TANK DOES NOT INCLUDE TEE BAFFLES

**NOTES:**

1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

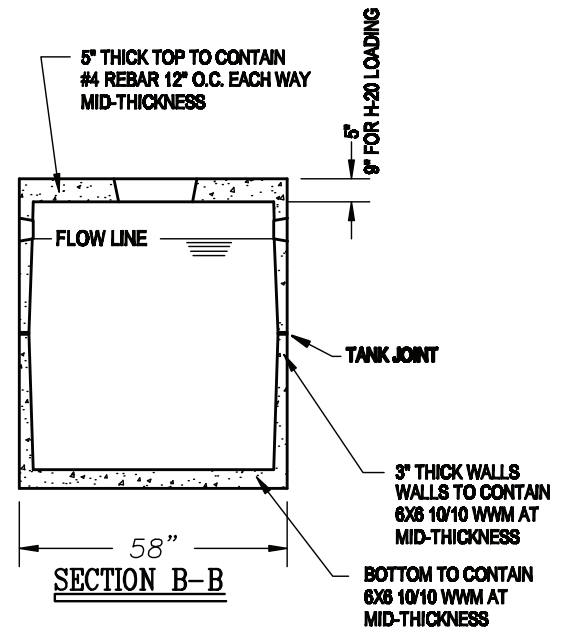





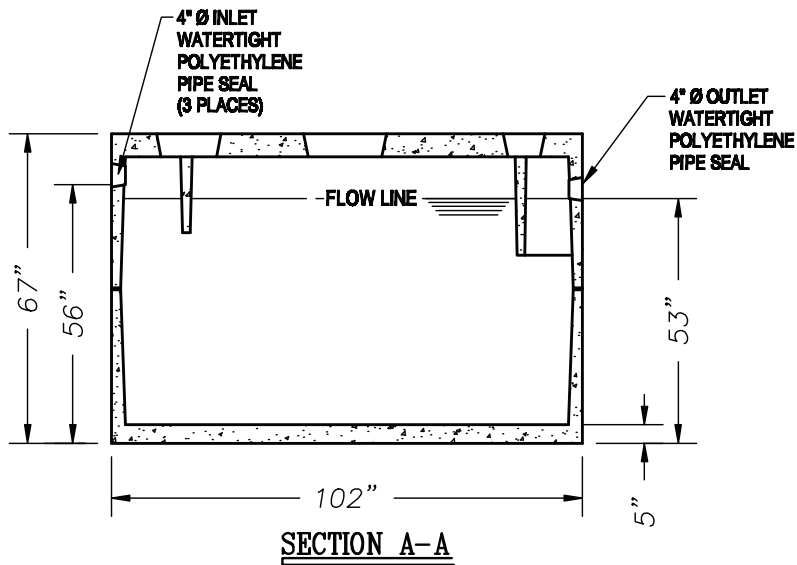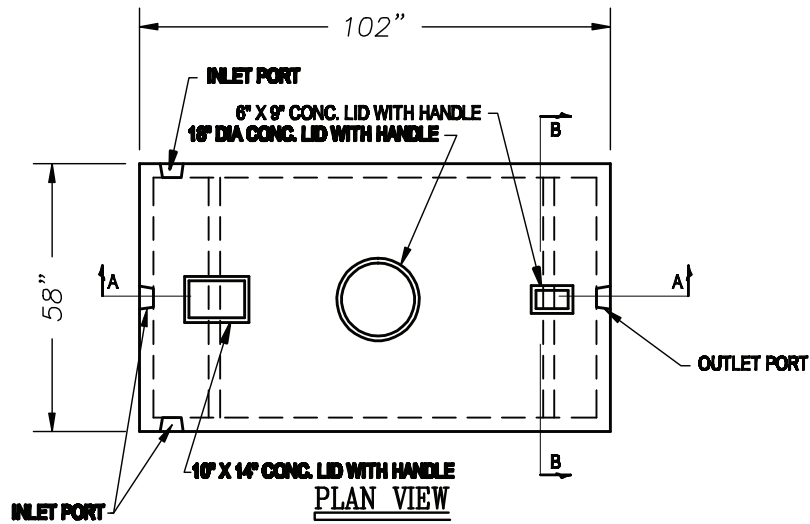

**NOTES:**



1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

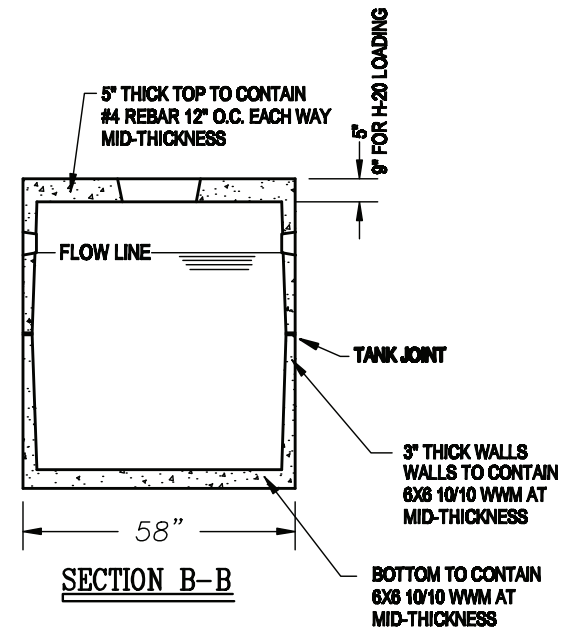


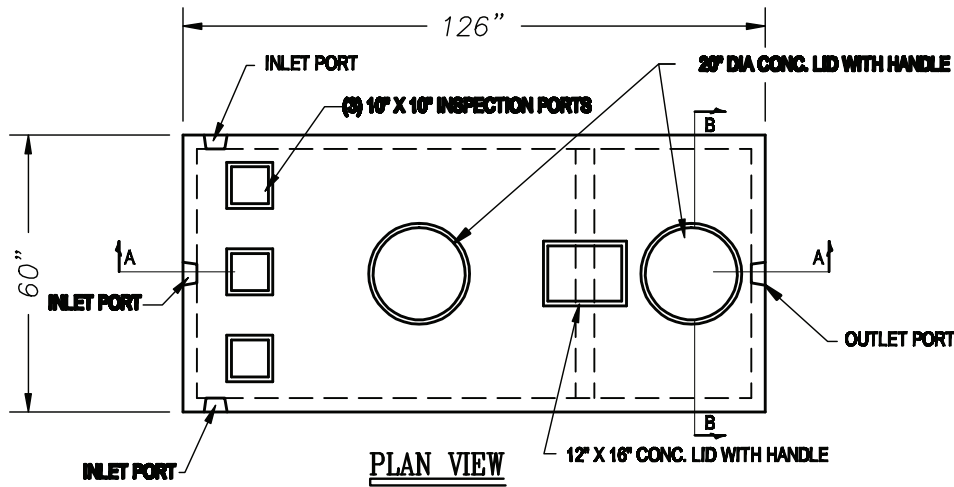

**NOTES:**



1. Two compartment mid-depth
2. Steel reinforcement: A.S.T.M. A496-A815 Grade 60-60 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Equipped with plastic baffles
7. Design loading A-0.3/ 300 pcf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

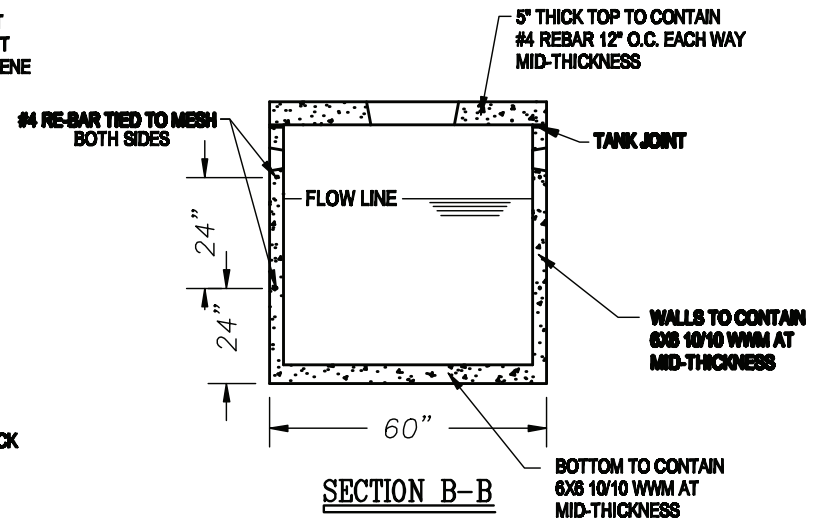
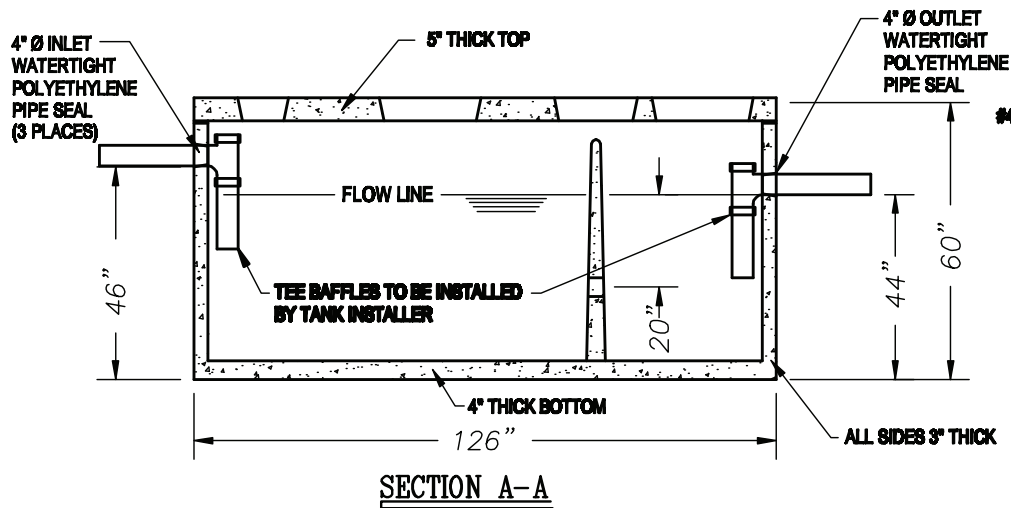


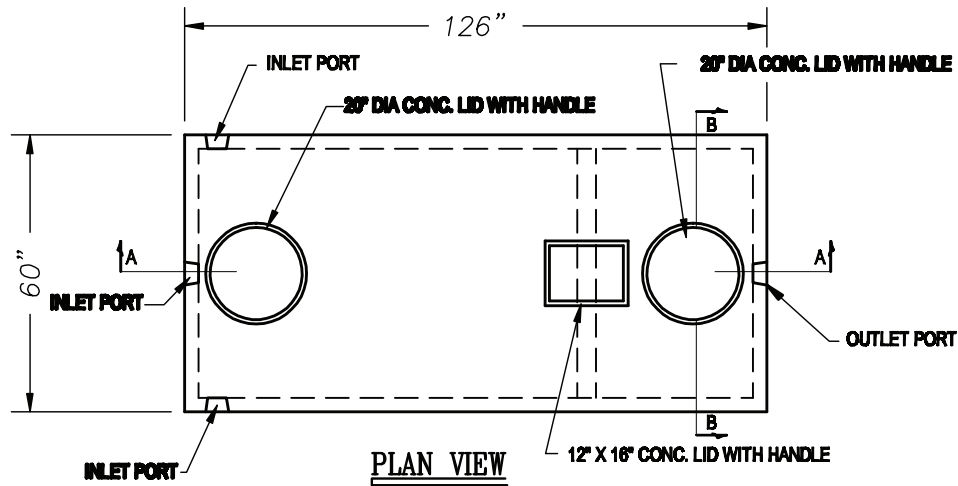

**NOTES:**

1. Two compartment mid-depth
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Equipped with plastic baffles
7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill

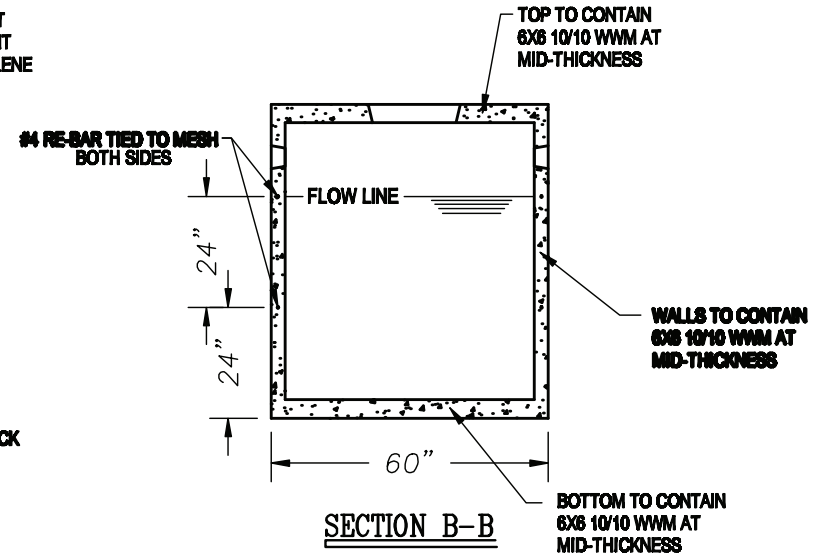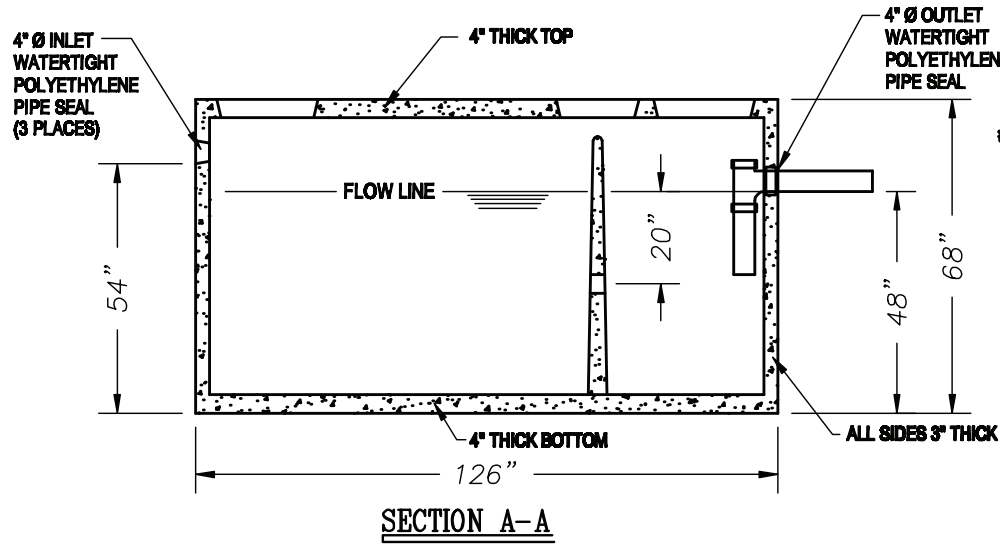


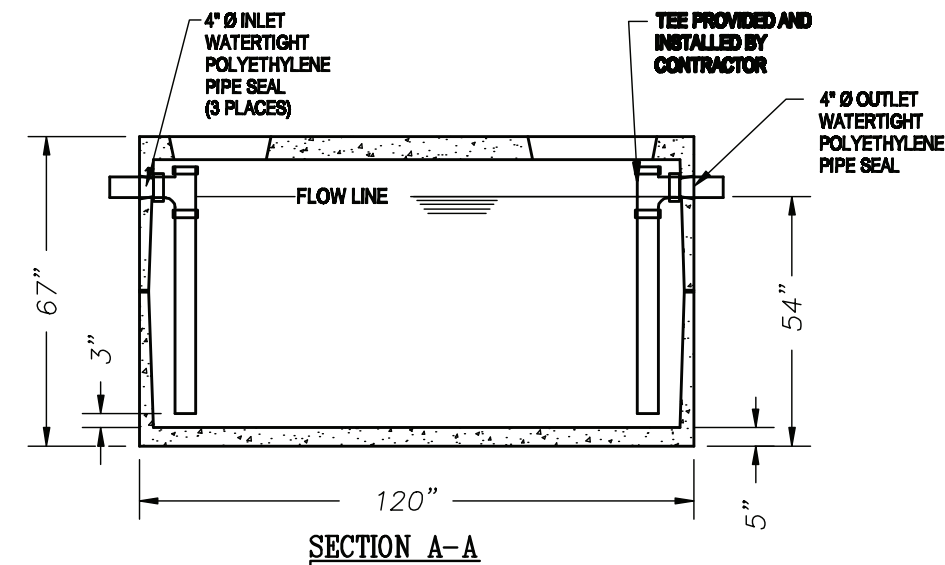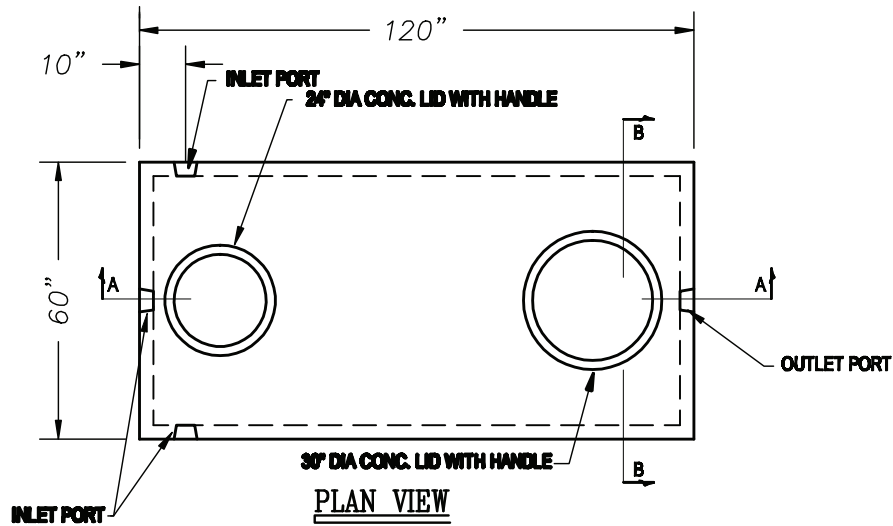


NOTE: PUMP TANK DOES NOT INCLUDE TEE BAFFLES


**NOTES:**

1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

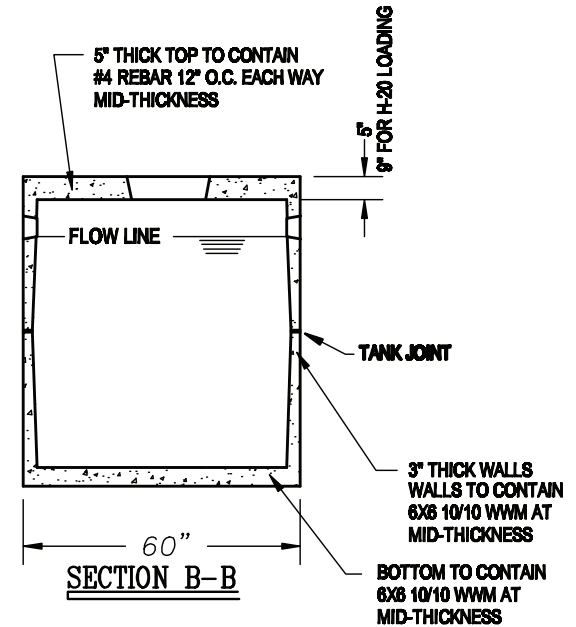


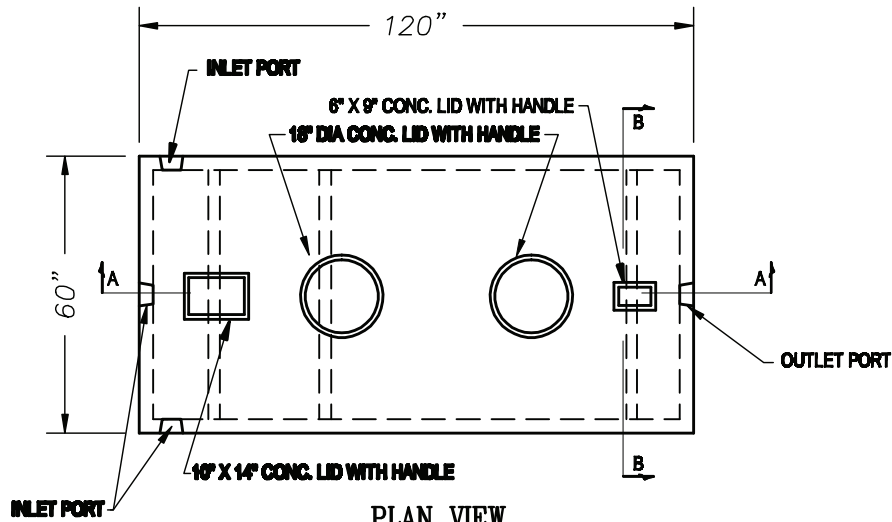

PLAN VIEW

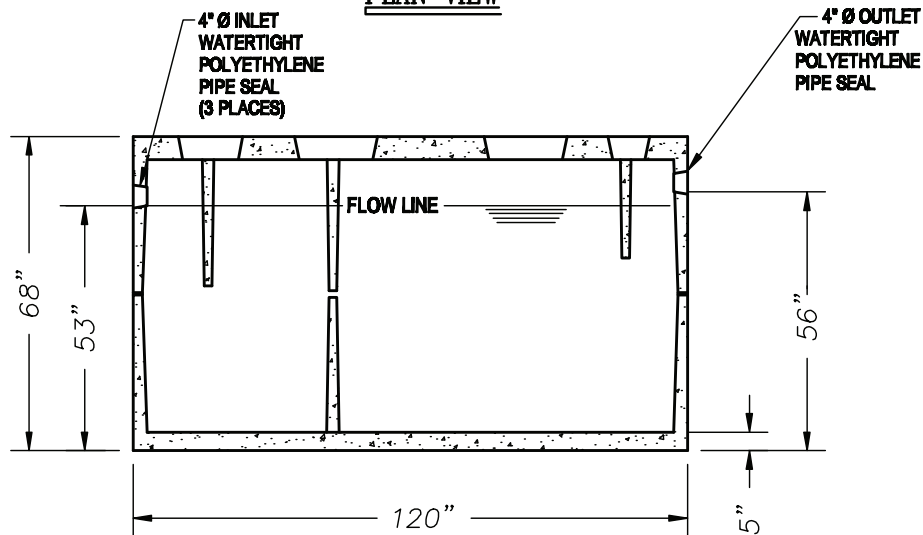


SECTION A-A

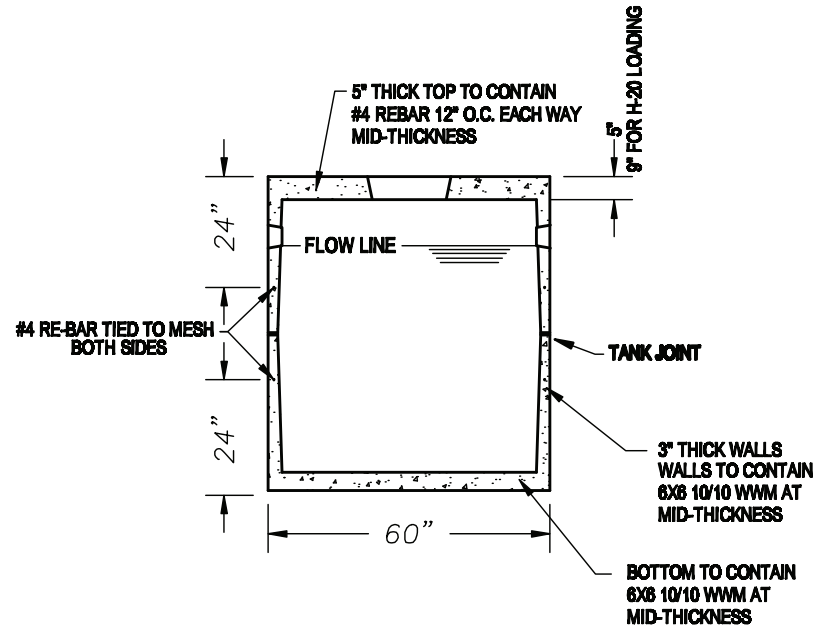

SECTION B-B



**NOTES:**



1. Two compartment mid-depth
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

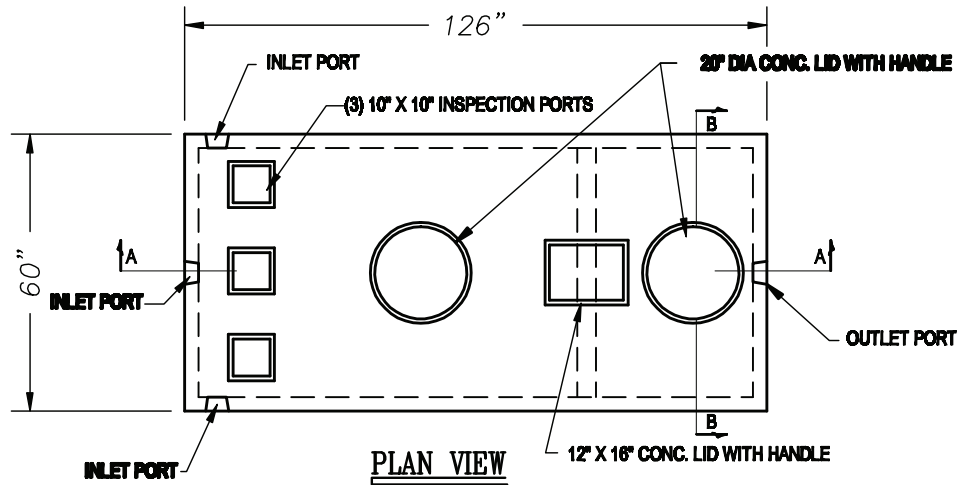

**NOTES:**

1. Two compartment mid-depth
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Equipped with plastic baffles
7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

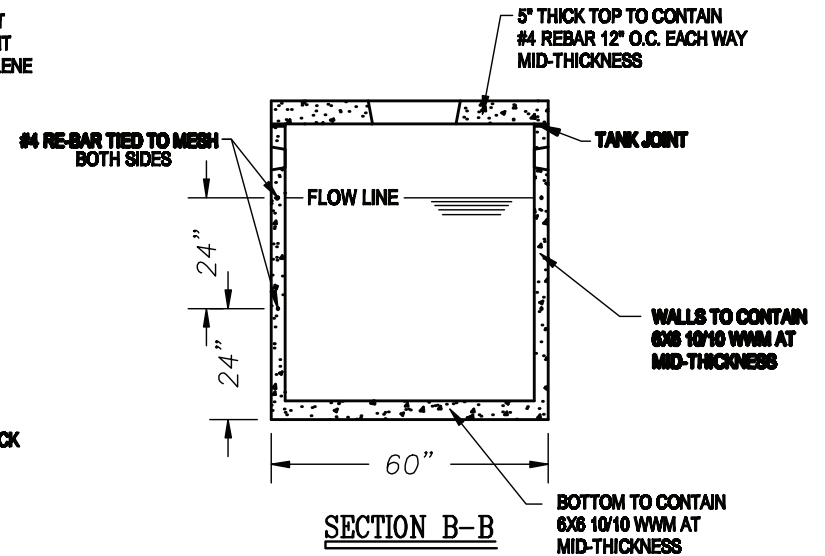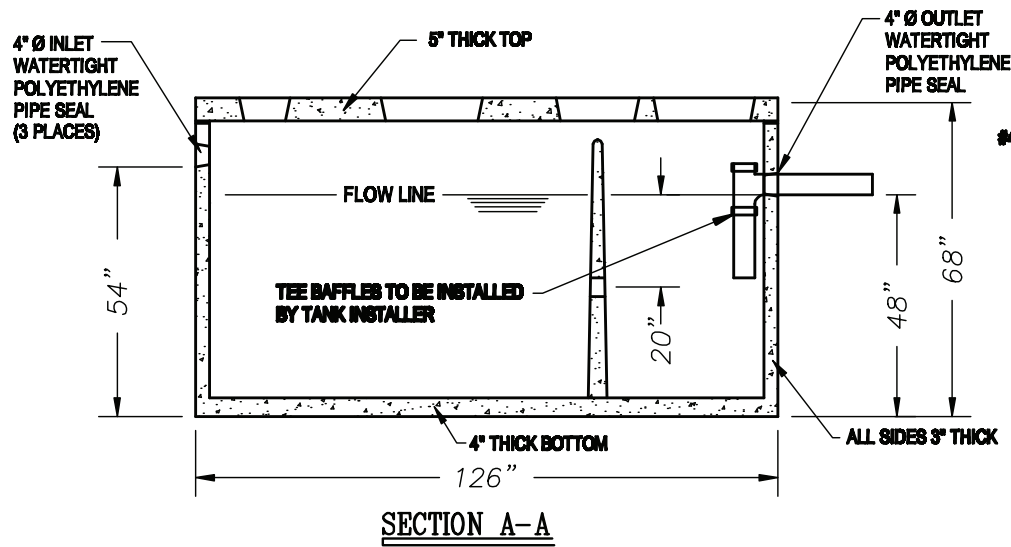



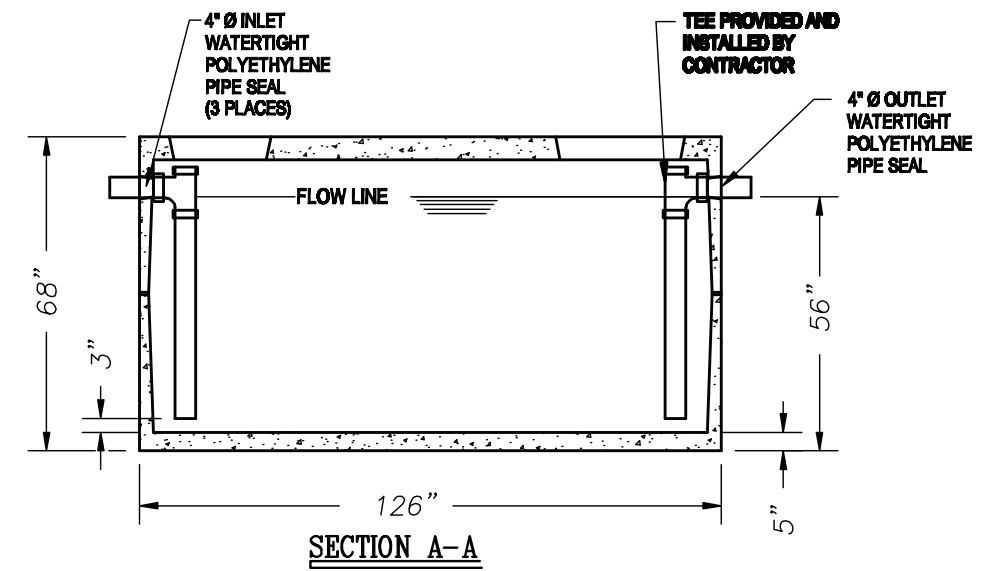
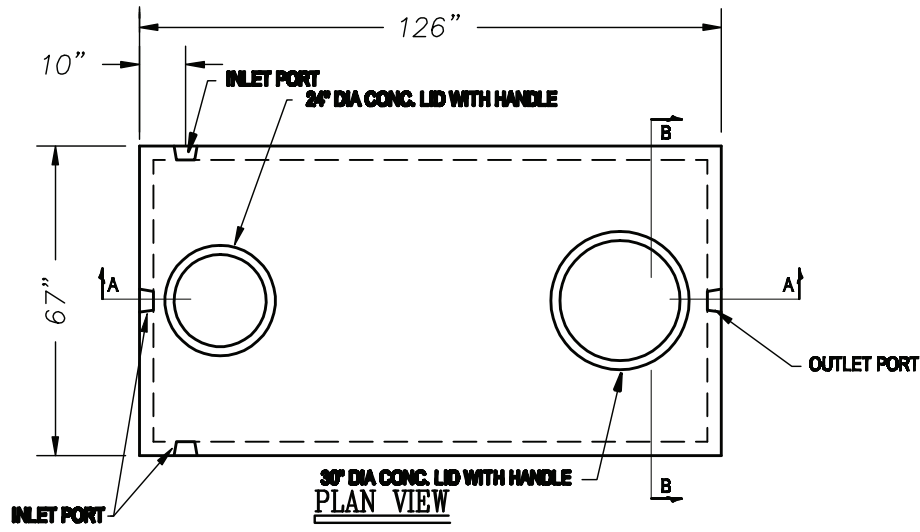


NOTE: PUMP TANK DOES NOT INCLUDE TEE BAFFLES

**NOTES:**


1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

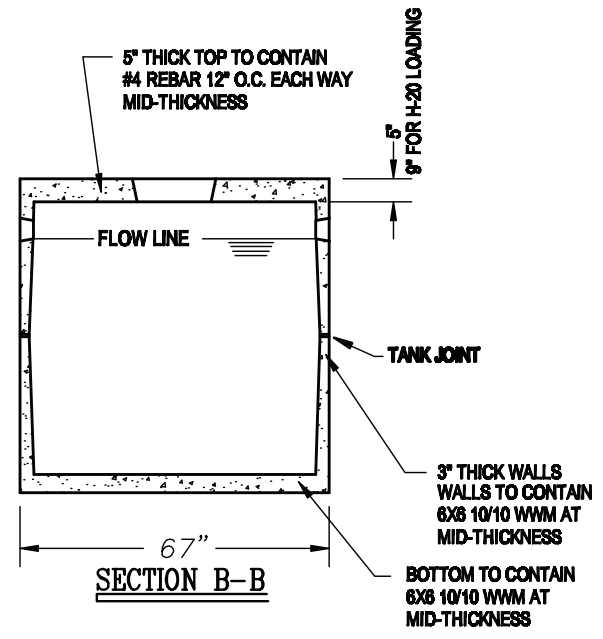

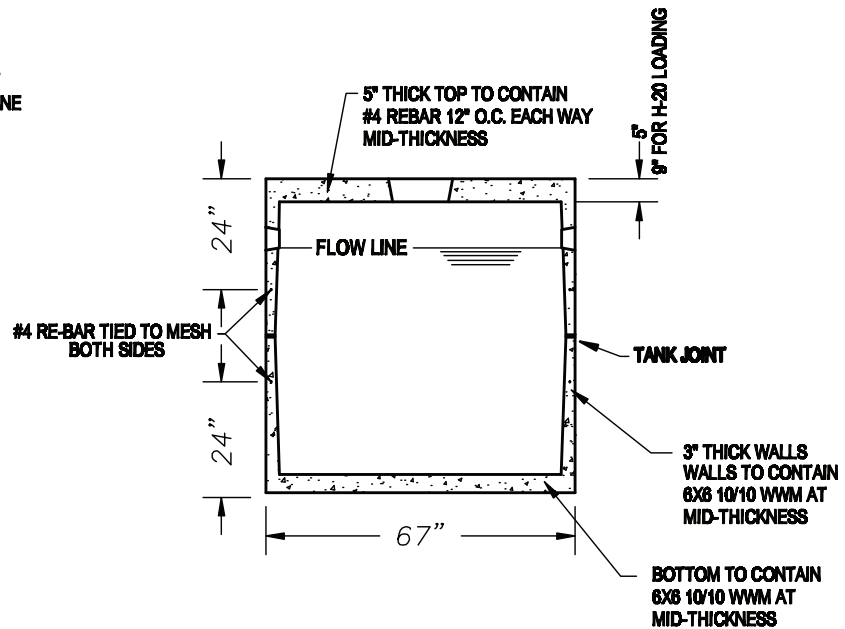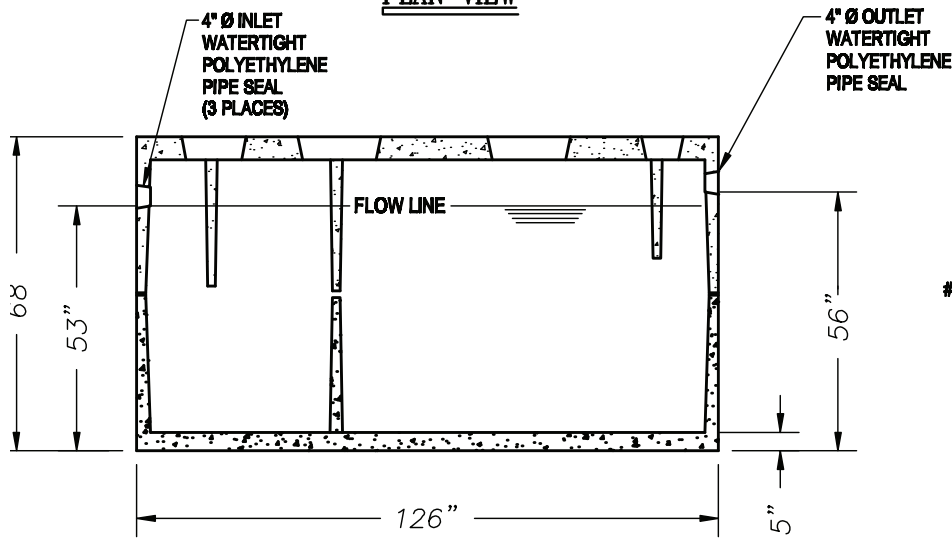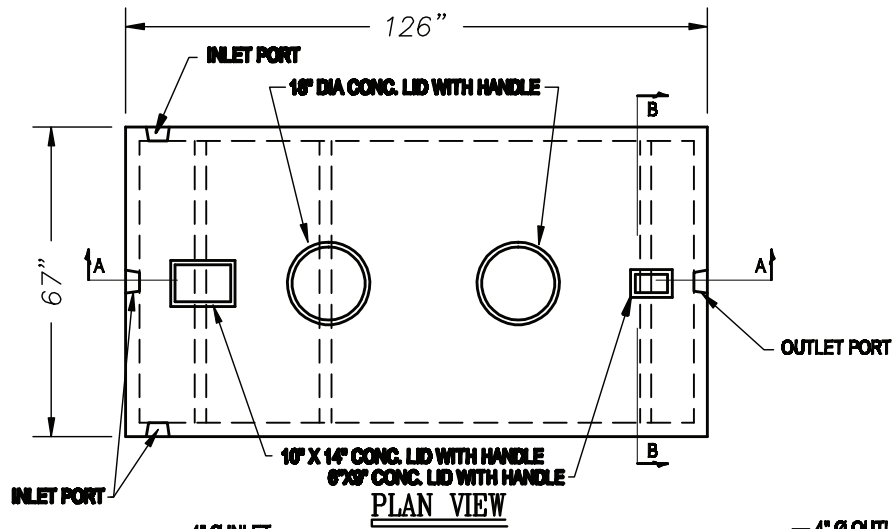



- NOTES:**
1. Two compartment mid-depth
  2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
  3. Joints sealed with asphalt cement or equal
  4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
  5. Equipped with polylok seals
  6. Intentionally left blank
  7. Design loading A-0.3/ 300 psi - walkways, flotation forces not accounted for
  8. Max. cover over tank: 3' of earth fill
  9. Min. 1" concrete cover over reinforcement
  10. Tank to conform with ASTM C1227







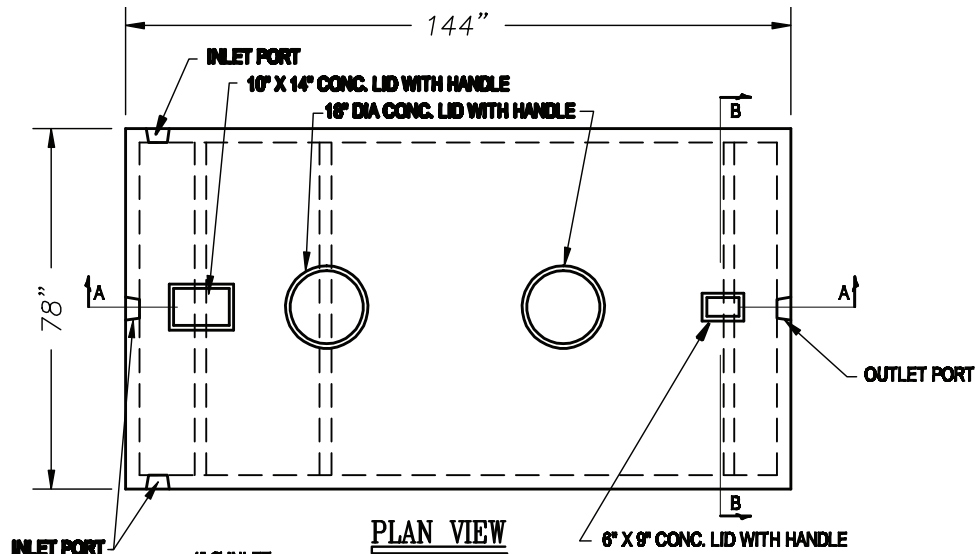

**NOTES:**



1. Two compartment mid-depth
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 pcf - walkways, flotation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

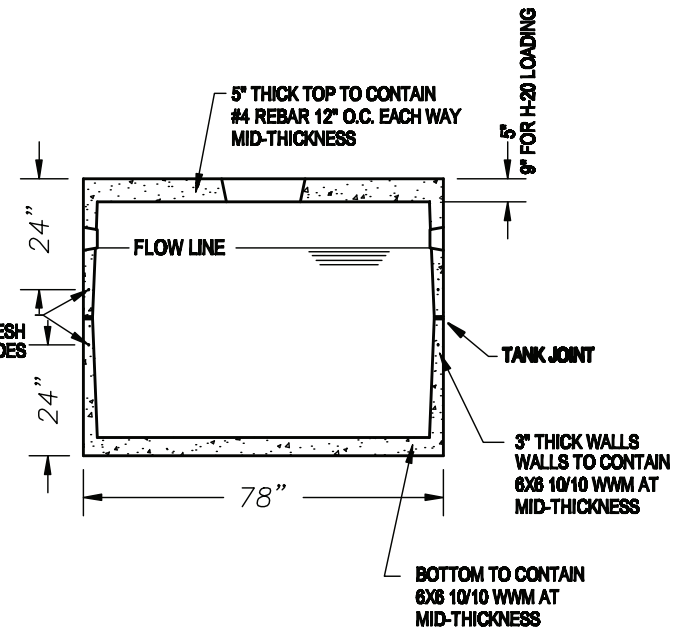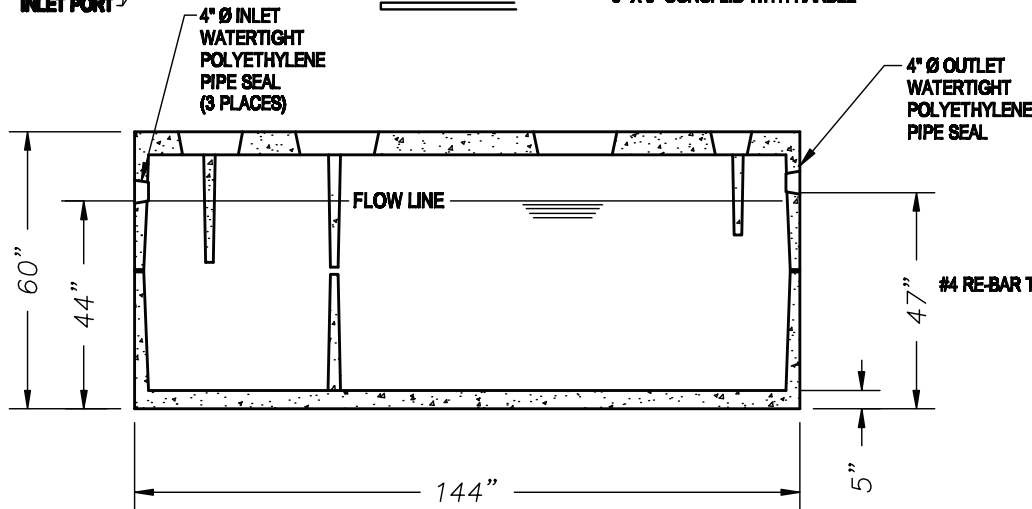

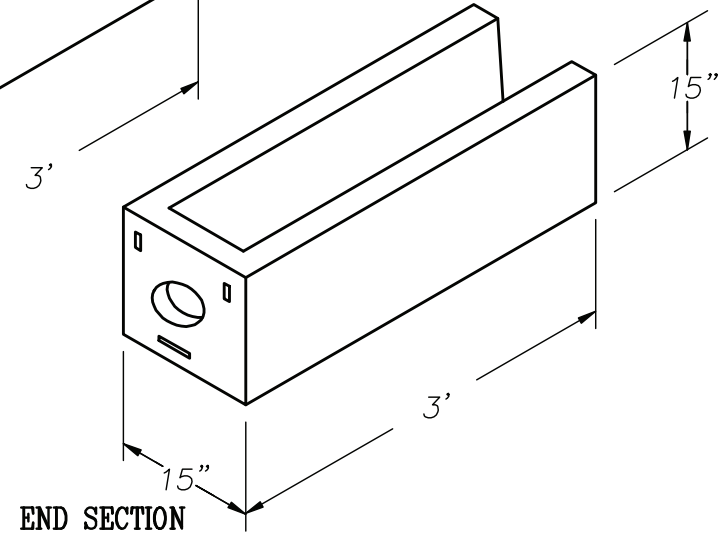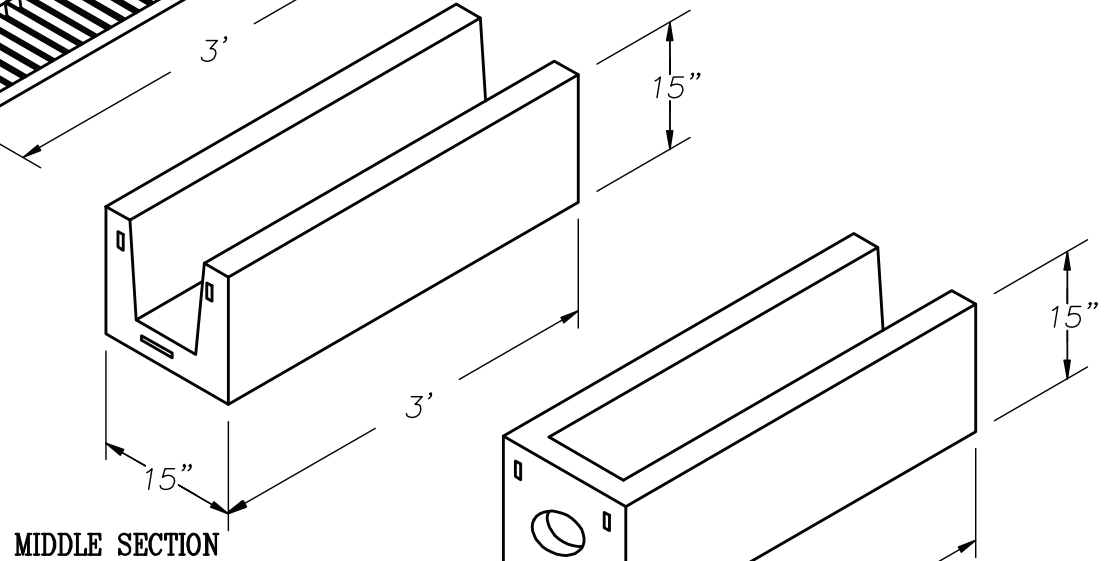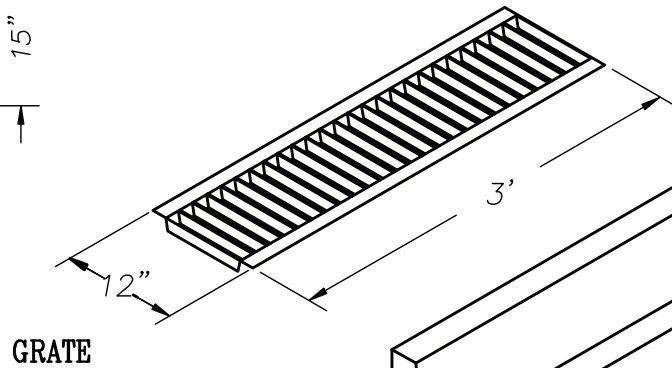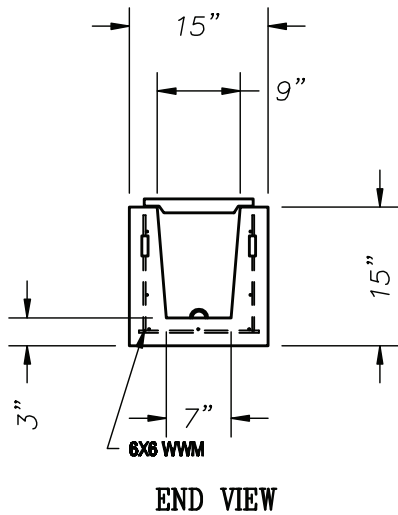

**NOTES:**


1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank

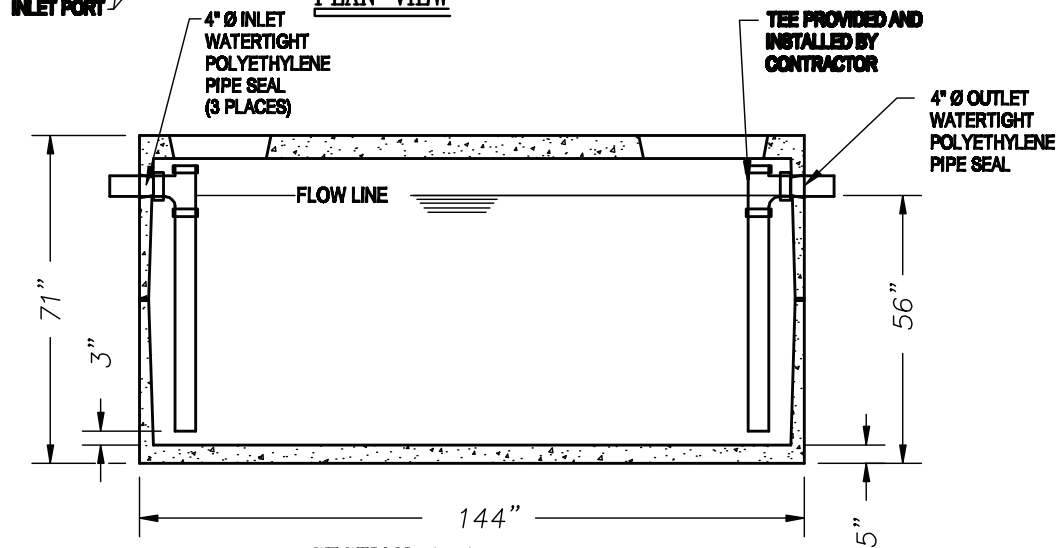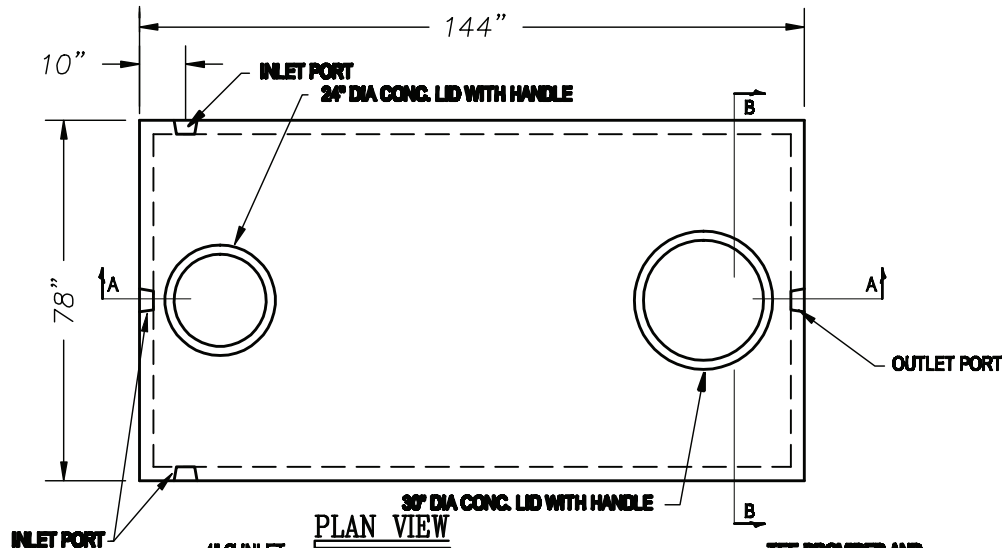


NOTE: PUMP TANK DOES NOT INCLUDE  
TEE BAFFLES

**NOTES:**



1. Intentionally left blank
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227


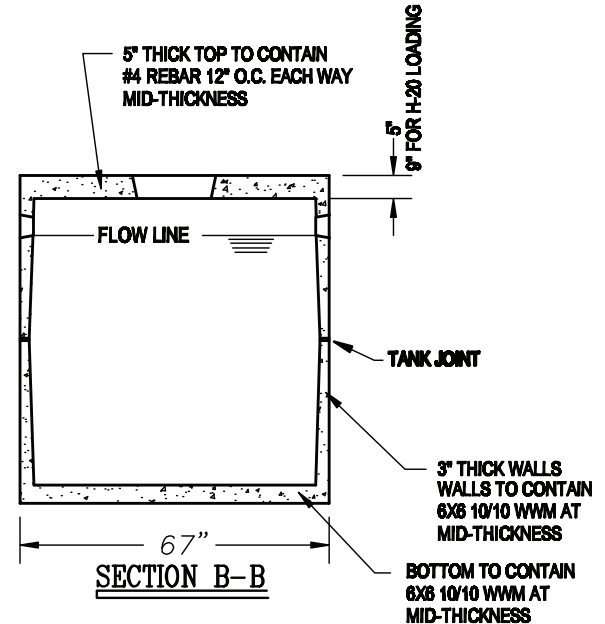


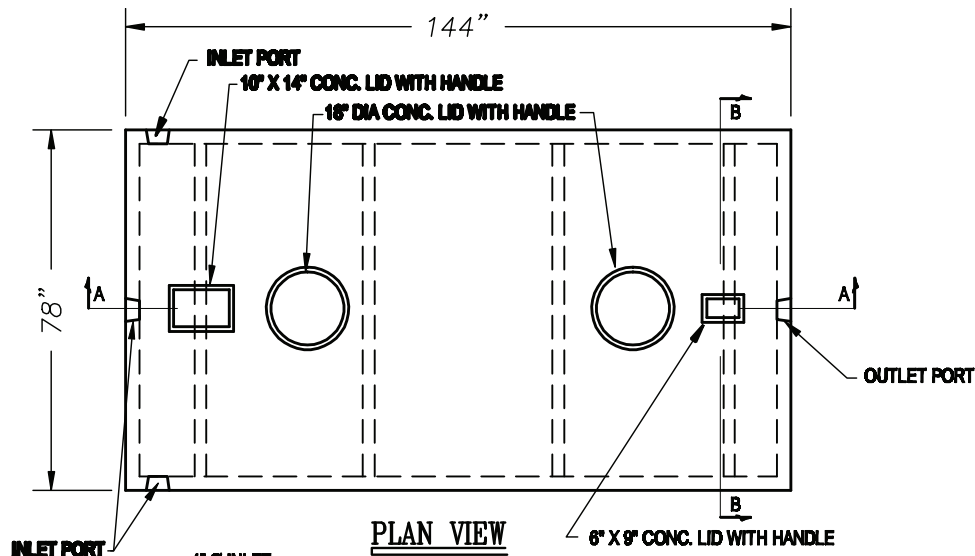

**NOTES:**


1. Two compartment mid-depth
2. Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi
3. Joints sealed with asphalt cement or equal
4. Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment
5. Equipped with polylok seals
6. Intentionally left blank
7. Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for
8. Max. cover over tank: 3' of earth fill
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

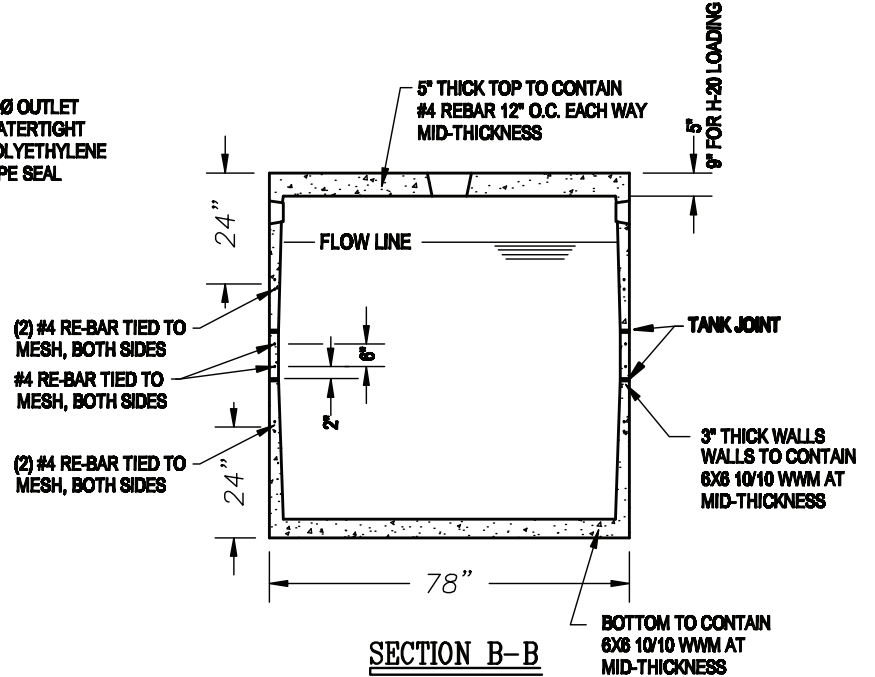
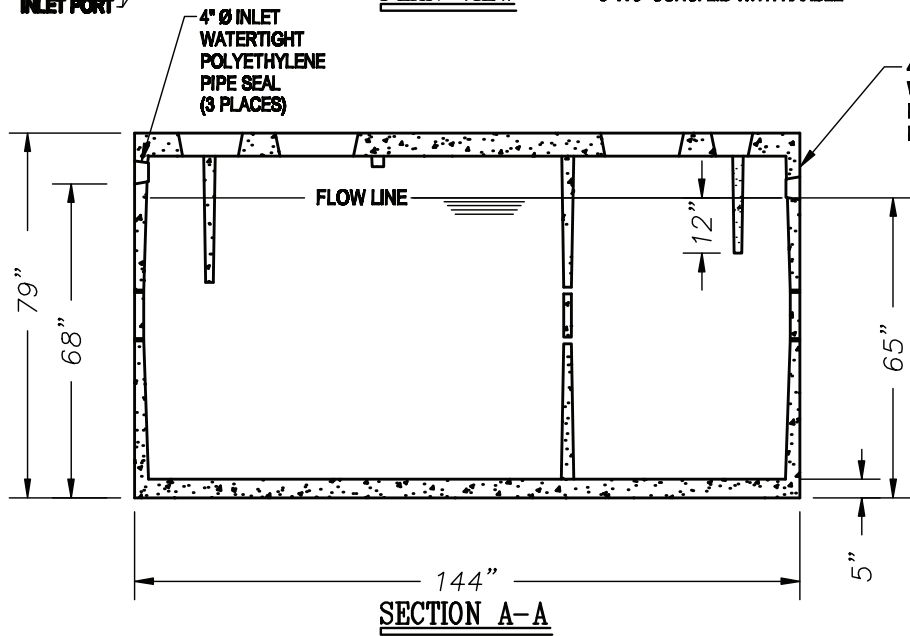


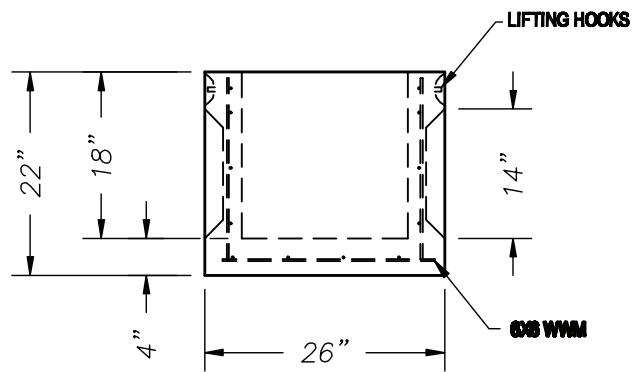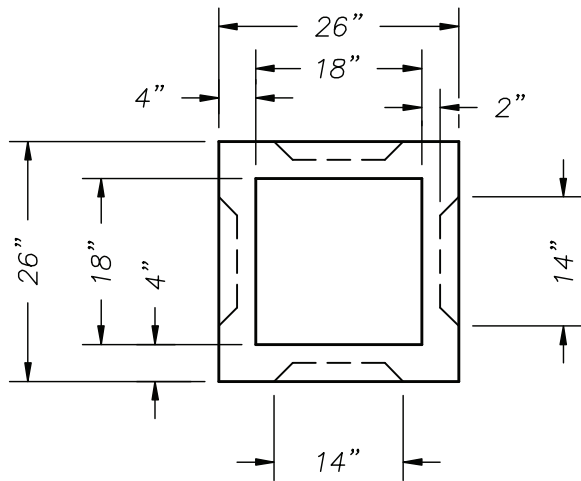

**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. Tank to conform with ASTM C1227

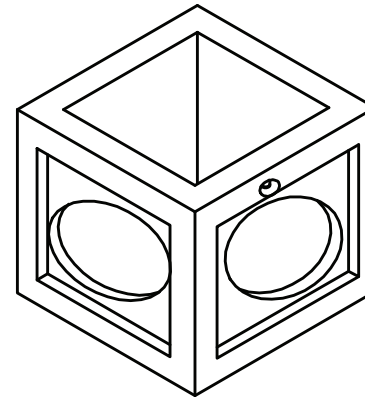


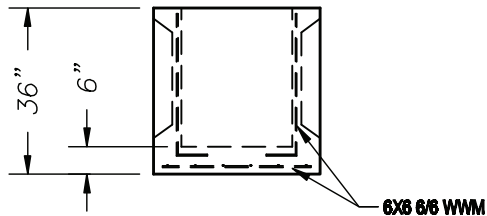
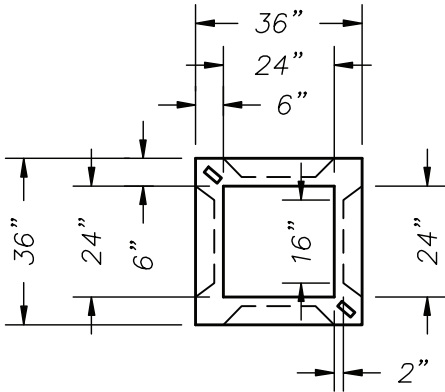


**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**


**PURPLE LIFTING LOOPS  
(2) RECESSED**


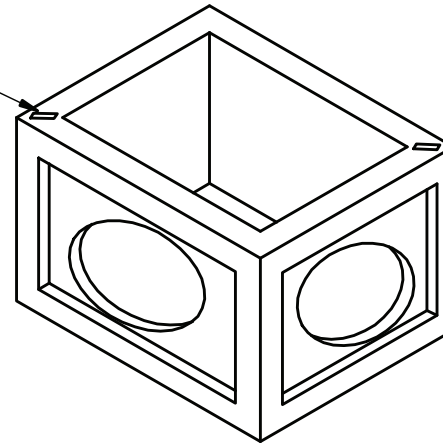


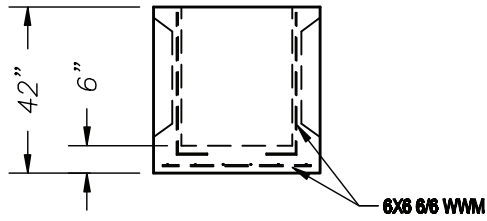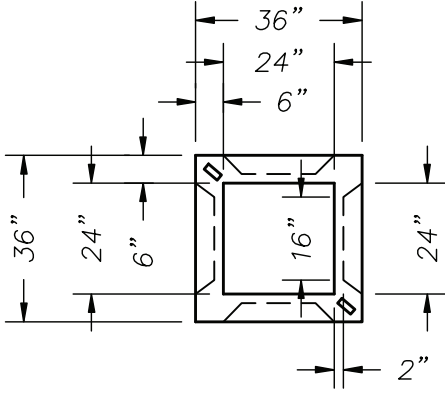

**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**

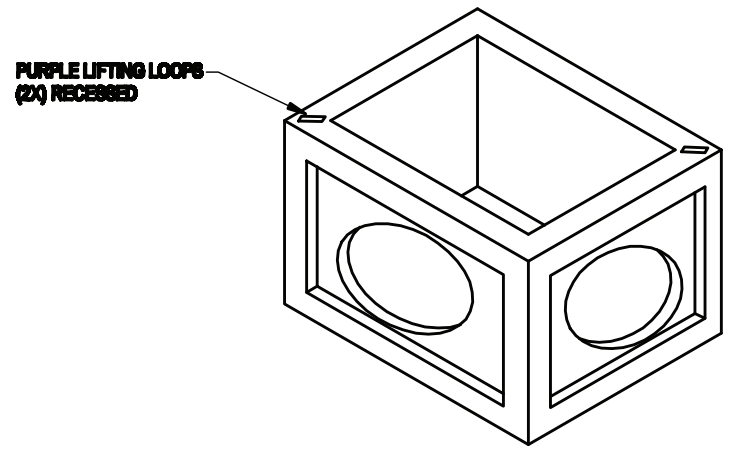


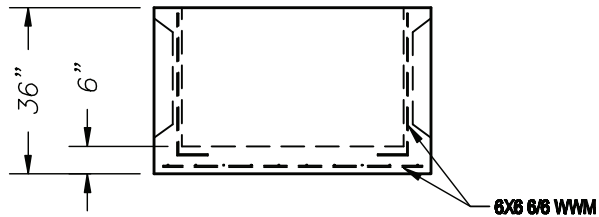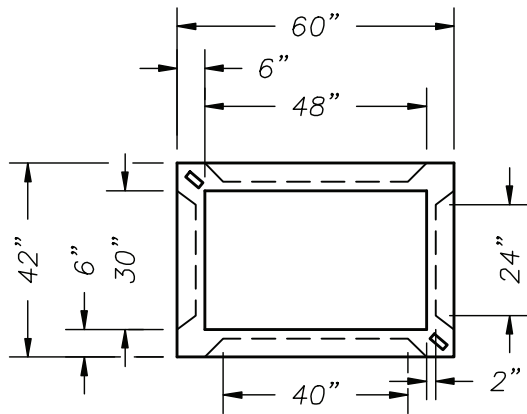


**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. Tank to conform with ASTM C1227


**PURPLE LIFTING LOOPS  
(2X) RECEIVED**

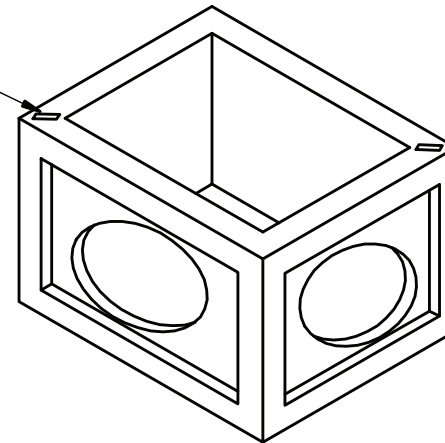



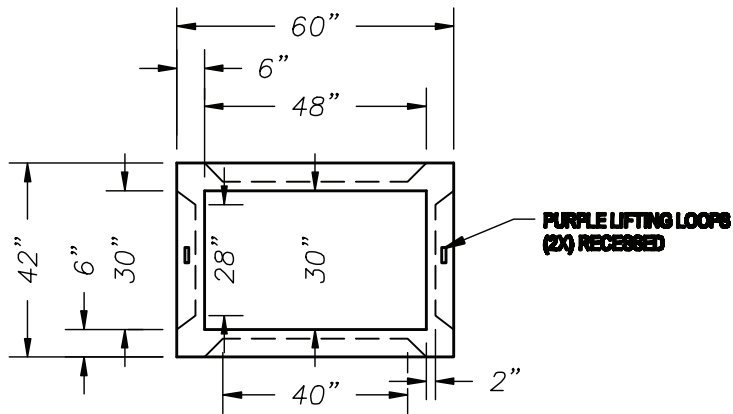


PURPLE LIFTING LOOPS  
(2) RECESSED

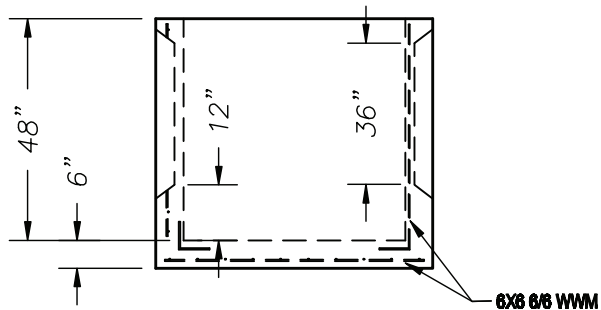

6x6 #6 W/M

PURPLE LIFTING LOOPS  
(2) RECESSED


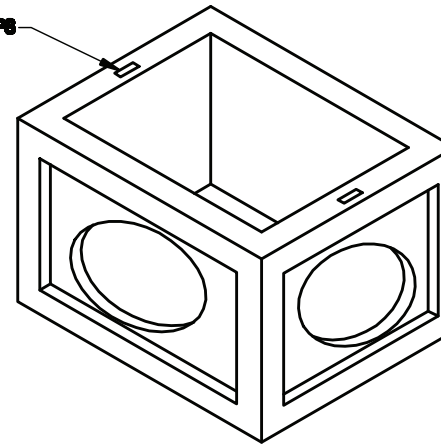



**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**

**NOTES:**

- 1. Intentionally left blank
- 2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi**
- 3. Intentionally left blank
- 4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**

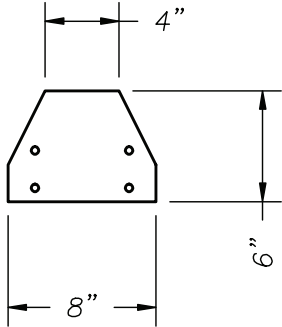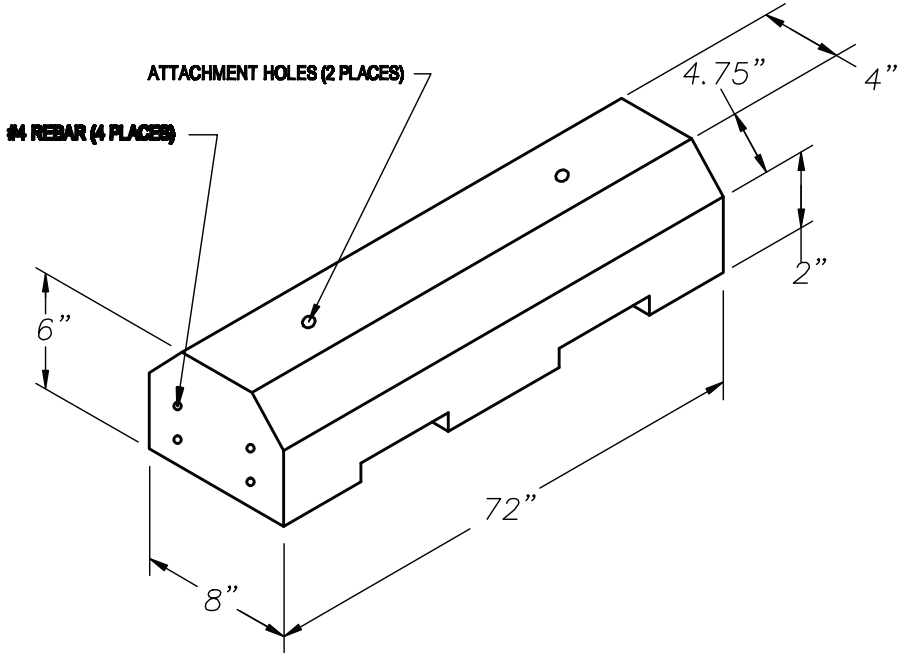

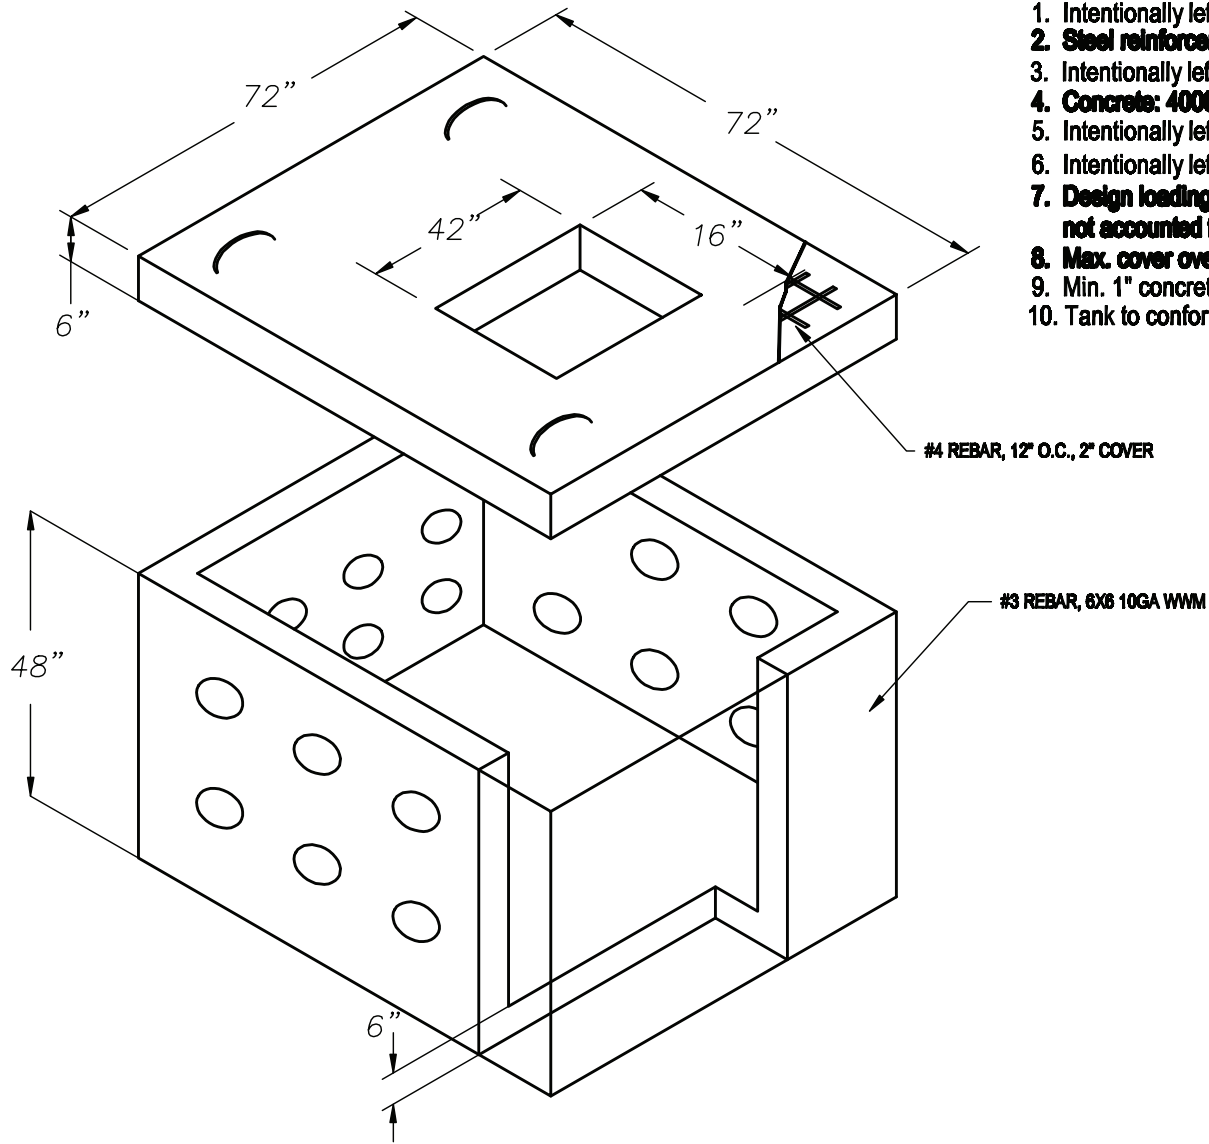




**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A815 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

**NOTES:**


- 1. Intentionally left blank
- 2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi**
- 3. Intentionally left blank
- 4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
- 5. Intentionally left blank
- 6. Intentionally left blank

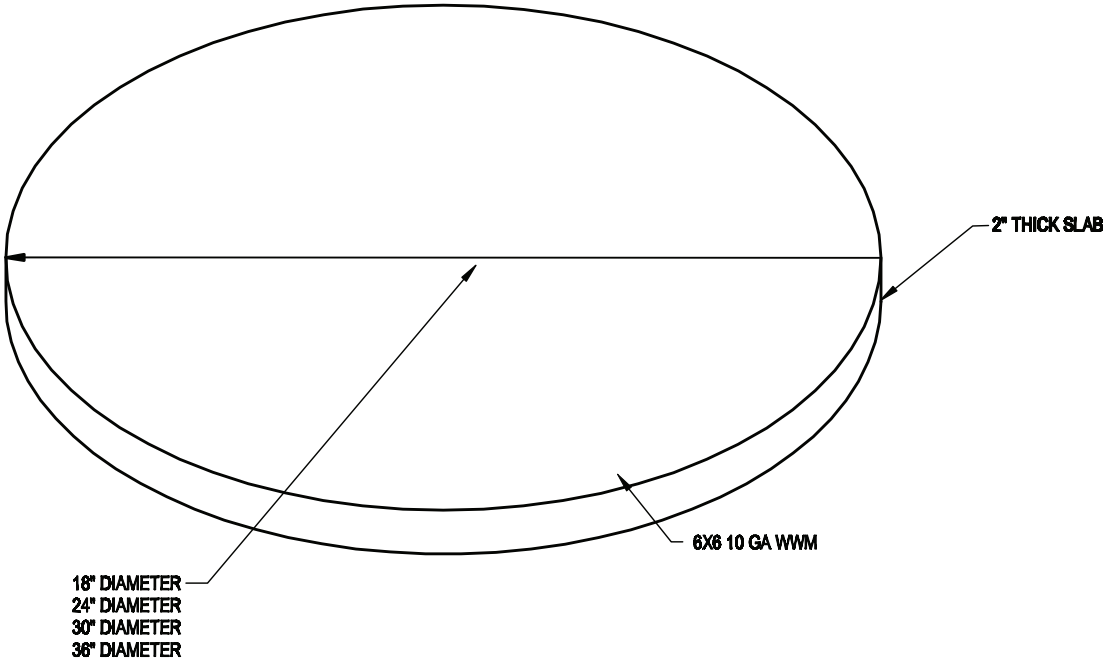


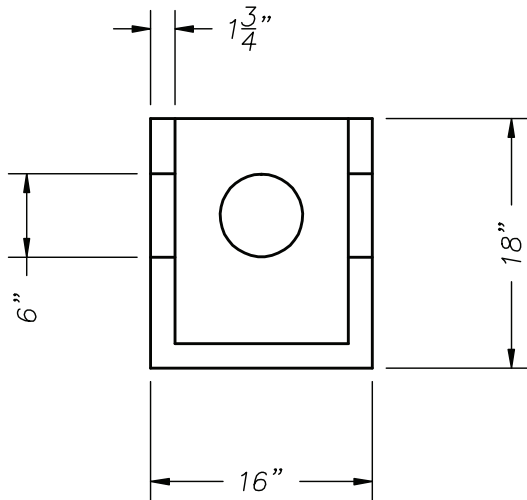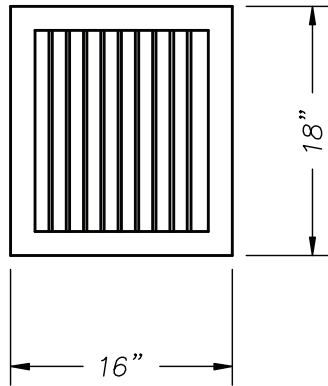

**NOTES:**




1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, floatation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. Min. 1" concrete cover over reinforcement
10. Tank to conform with ASTM C1227

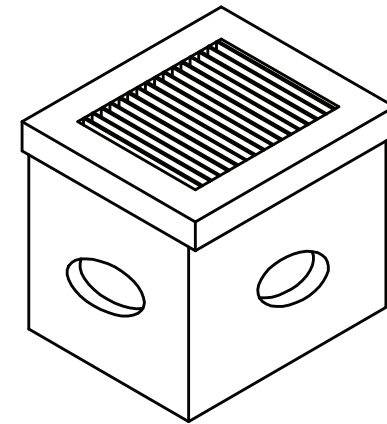

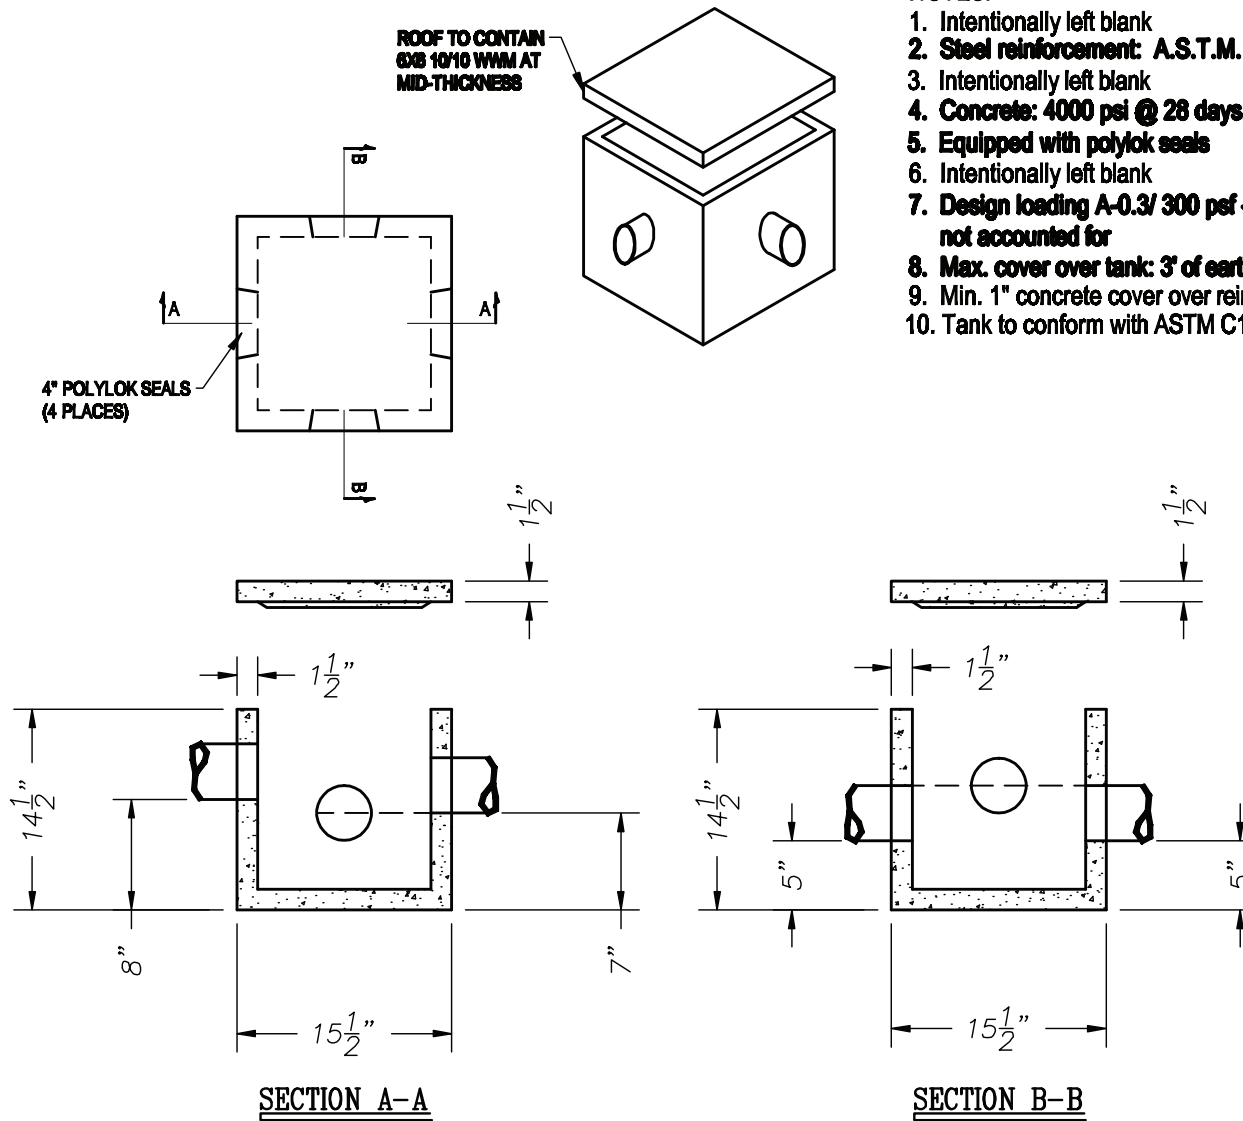


**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-80 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. **Equipped with polylok seals**
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**

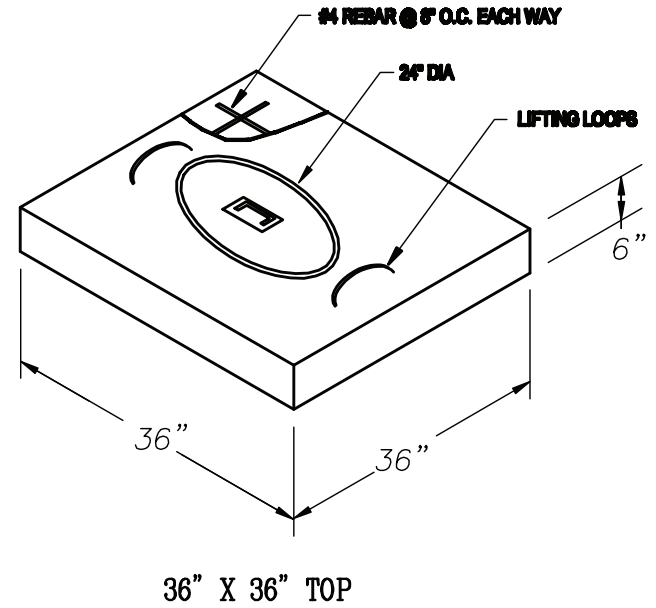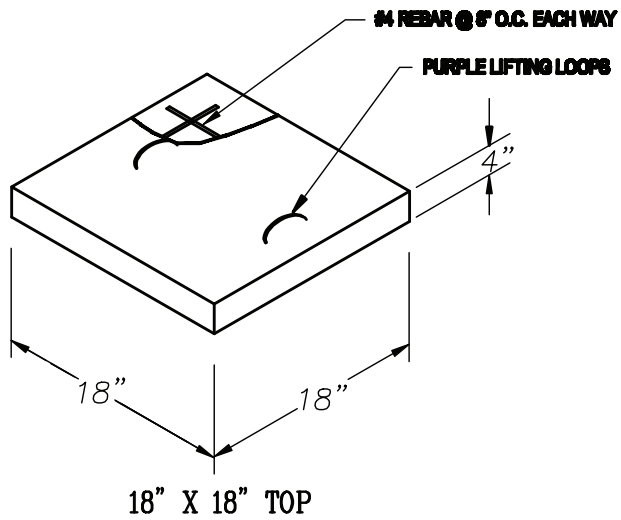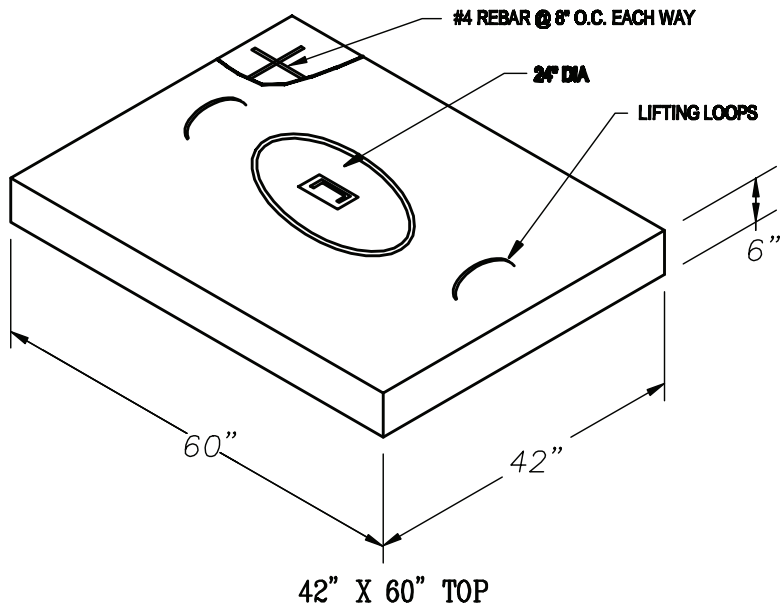

**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A815 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank

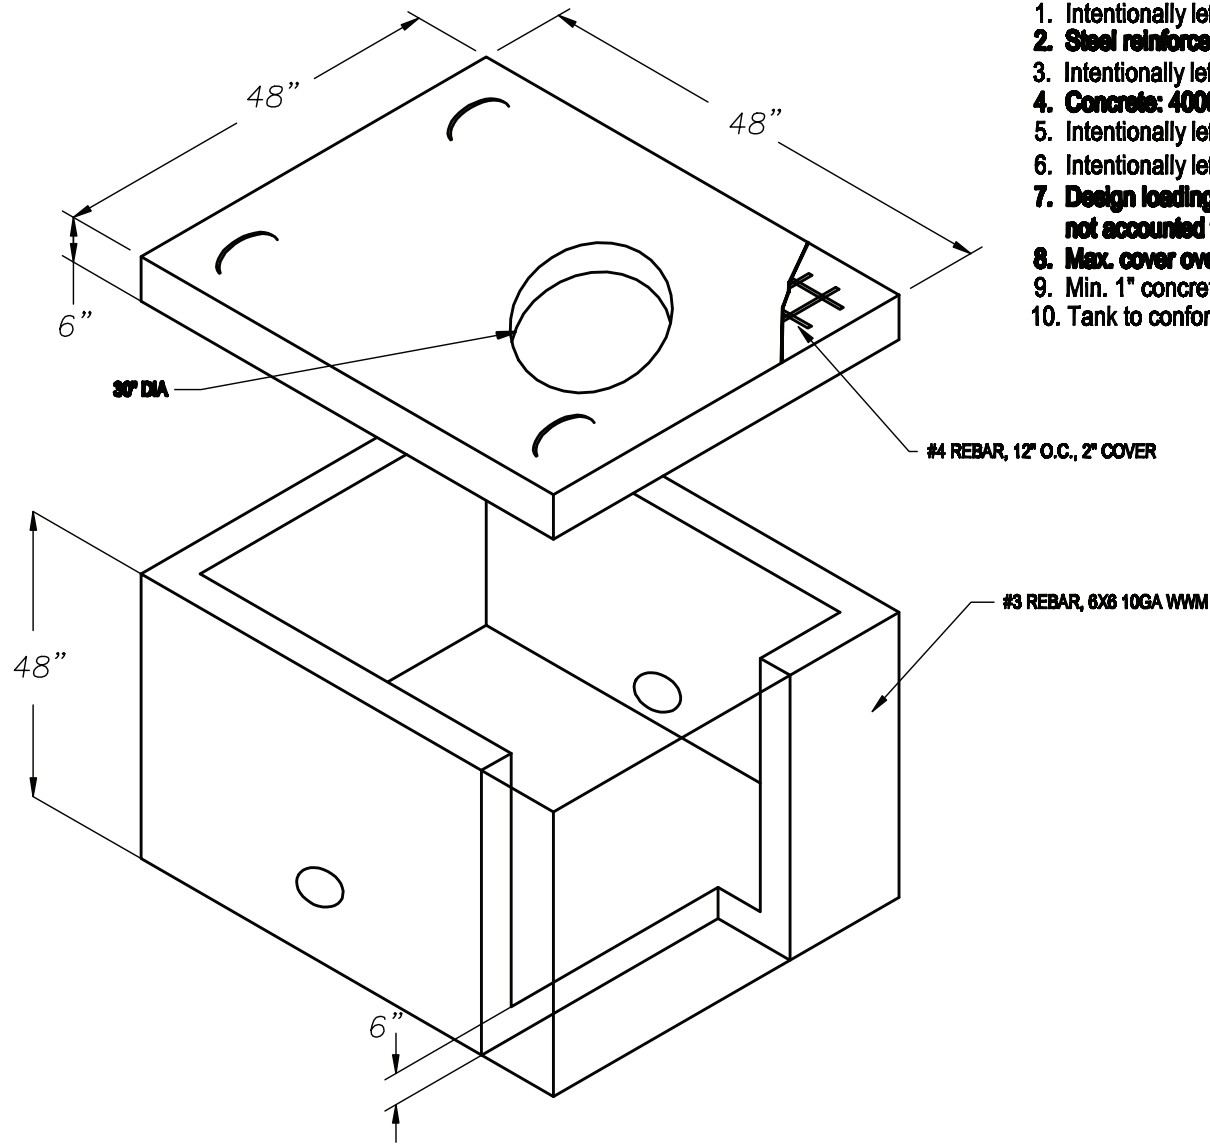

**NOTES:**

1. Intentionally left blank
2. **Steel reinforcement: A.S.T.M. A496-A615 Grade 60-60 ksi**
3. Intentionally left blank
4. **Concrete: 4000 psi @ 28 days, 5% - 9% air entrainment**
5. Intentionally left blank
6. Intentionally left blank
7. **Design loading A-0.3/ 300 psf - walkways, flotation forces not accounted for**
8. **Max. cover over tank: 3' of earth fill**
9. **Min. 1" concrete cover over reinforcement**
10. **Tank to conform with ASTM C1227**